


MANITOBA HEALTH

HEALTHY LIVING AND HEALTH PROGRAMS

PUBLIC HEALTH BRANCH

COMMUNITY WATER FLUORIDATION PROGRAM

2006 / 2007

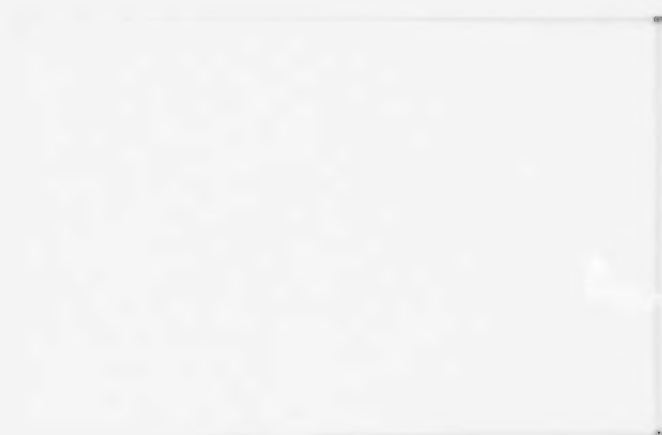

MANITOBA HEALTH

HEALTHY LIVING AND HEALTH PROGRAMS

PUBLIC HEALTH BRANCH

COMMUNITY WATER FLUORIDATION PROGRAM

2006 / 2007

Prepared by:
ALS Laboratory Group
(Manitoba Technology Centre Ltd.)
in conjunction with
Manitoba Health



TABLE OF CONTENTS

INTRODUCTION	1
I. STATUS OF FLUORIDATION IN MANITOBA	2
COMMUNITIES WITH A FLUORIDATED WATER SUPPLY TABLE I	3-5
II. FLUORIDATION GRANT	
A. OVERVIEW	6
B. NEW PARTICIPANTS AND UPGRADES	6
III. EQUIPMENT	
A. OVERVIEW	7
B. FLUORIDATION SYSTEMS	7
C. OPERATING PROBLEMS	8
IV. MONITORING PROGRAM	
A. OVERVIEW	9
B. RESULTS	10
BI-WEEKLY SAMPLING RESULTS - 2006 / 2007 SUMMARY TABLE II	11
C. CERTIFICATES 2006 / 2007	12
EXCELLENCE RECIPIENTS	13
COMMENDATION RECIPIENTS	14
V. MANITOBA WATER SERVICES BOARD	15
VI. SUPPORT SERVICES	16
VII. FLUORIDE CONTROL DATA - 2006 / 2007	17
(Listed by location of the water treatment plant.)	
FLUORIDE CONTROL DATA - 2006 / 2007 SUMMARY - TABLE III	18-19
FLUORIDE CONTROL DATA KEY	20
AUSTIN	21
BALDUR	22
BENITO	23
BINSCARTH	24
BIRTLE	25
BOISSEVAIN	26
BRANDON	27
CARMAN	28
CARTIER REGIONAL	29
CHURCHILL	30

TABLE OF CONTENTS continued

Page

CRANBERRY PORTAGE	31
CROSS LAKE RESERVE	32
DAUPHIN	33
DELORAINÉ	34
FLIN FLON	35
GILBERT PLAINS	36
GILLAM	37
GIMLI INDUSTRIAL PARK	38
GLADSTONE	39
GRISWOLD SIOUX VALLEY BAND	40

HAMIOTA	41
HARTNEY	42
KILLARNEY	43
LETELLIER-RRRWTP	44
LONG PLAIN	45
MANITOU	46
MELITA	47
MINNEDOSA	48
MORDEN	49
MORRIS	50
NEEPAWA	51

PILOT MOUND	52
PINAWA	53
PORTAGE LA PRAIRIE	54
RESTON	55
RIVERS	56
ROBLIN	57
ROSSBURN	58
RUSSELL	59
SANFORD (RM MACDONALD)	60
SAPOTAWYAK	61
SHILO	62
SOMERSET	63
SOURIS	64

STEINBACH	65
STEPHENFIELD	66
SWAN RIVER	67
THE PAS	68
TREHERNE	69
VIRDEN	70
WABOWDEN	71
WINKLER	72
WINNIPEG	73
WINNIPEGOSIS	74

INTRODUCTION

This report is a brief summary of the performance of Manitoba Health's Community Water Fluoridation Program for the 2006 / 2007 fiscal year.

I. STATUS OF FLUORIDATION IN MANITOBA - 2006/2007

A total of fifty-four (54) water treatment plants provide fluoridated water to approximately eighty-nine (87) communities. Approximately 95% of the population served by a public water system receive fluoridated water. Population statistics are based on the 1996 census figures unless otherwise indicated. Included in the above statistics are an estimated number of rural residents who consume water transported from a fluoridated water supply.

Manitoba Health operates a province-wide fluoride level monitoring program for all fluoridating communities. All online water treatment plants participated in the monitoring program.

Manitoba Health offers a grant for communities wishing to install a fluoridation system in their communal water system. Assistance is provided in the design and selection of suitable fluoridation systems/equipment.

Training in equipment operation and maintenance, testing procedures, safety standards and monitoring protocol is provided initially to all communities. Technical assistance and support is then provided on an ongoing basis.

NOTE: Population statistics are from 2006 census.

Water Plant Location	Status	Population	Ministerial Approval	Dates On-Line	Background Level	Chemical Feed	Average F mg/L	Water Source	Water Plant Owner
AUSTIN	Region	N/A	88/12/15	88/12/15	0.19	Na2SiF6 (Dry)	1.0	River	RM
BALDUR	Village	N/A	66/09/19	67/11/15	0.22	NaF 4 %	0.9	Well	RM
BENITO	Village	370	91/08/01	91/08/01	0.3	NaF 4 %	1.0	River	Village
BINSCARTH	Village	395	94/11/01	95/07/19	0.24	H2SiF6 25 %	0.8	Well	Village
BIRTLE	Town	662	89/05/04	87/11/07	0.26	NaF 4 %	1.0	Well	Town
BOISSEVAIN	Town	1497	56/11/05	57/01/11	0.2	NaF 4 %	0.9	SI	Town
BRANDON	City	41511	53/08/11	55/03/08	0.2	Na2SiF6 (Dry)	0.9	River	City
CARMAN	Town	2880	65/06/22	65/06/22	0.21	H2SiF6 25 %	0.8	River	Town
CARTIER REGIONAL	Region	N/A *	00/06/13	00/06/13	0	H2SiF6 25 %	0.9	River	Private
CHURCHILL	Town	923	94/11/01	95/10/04	< 0.10	H2SiF6 25 %	0.9	River	LGD
CRANBERRY PORTAGE	UVD	N/A	83/03/19	83/12/14	< 0.10	NaF 4 %	1.0	Lake	RM
CROSS LAKE RESERVE	Reserve	4000^	92/05/02	92/05/02	< 0.10	NaF 4 %	1.1	River	Reserve
DAUPHIN	City	7906	57/08/02	80/05/03	0.14	H2SiF6 25 %	1.0	SI	Town
DELORAINE	Town	977	67/07/28	68/09/24	0.16	NaF 4 %	0.9	SI	Town
FLIN FLON	City	5594	61/07/01	89/12/15	< 0.10	H2SiF6 25 %	1.0	Lake	City
GILBERT PLAINS	Village	760	89/02/22	89/02/22	0.19	NaF 4 %	0.8	Well	Village
GILLAM	LGD	1209	74/08/14	87/01/03	< 0.10	H2SiF6 25 %	1.0	River	LGD
GIMLI INDUSTRIAL PARK	Town	N/A	63/08/01	63/12/23	0.43	NaF 4 %	0.9	Well	Town
GLADSTONE	Town	802	71/04/19	76/09/23	0.22	Na2SiF6 (Dry)	0.9	River	Town
GRISWOLD SIOUX VALLEY BAND	Reserve	N/A	99/11/01	99/11/26	0.1	NaF 4 %	0.7	Well	Reserve
HAMIOTA	Village	823	70/05/27	70/08/17	0.29	NaF 4 %	1.1	Well	Town
HARTNEY	Town	400	64/01/02	64/12/16	0.2	NaF 4 %	1.4	Well	Town
KILLARNEY	Town	2199	60/10/12	60/10/25	0.19	NaF 4 %	1.0	Lake	Town
LETELLIER-RRRWTP	Region	N/A	89/05/04	87/05/13	0.17	H2SiF6 25 %	1.0	River	PVWC
LONG PLAIN	Reserve	752	94/03/02	94/03/02	0.23	NaF 4 %	0.8	Well	Reserve

KEY:

1. Status

CFB - Canadian Forces Base
 LGD - Local Government District
 UVD - Unincorporated Village District

2. Type of Chemical Feed

H2SiF6 - Fluorosilicic Acid
 NaF - Sodium Fluoride
 Na2SiF6 - Sodium Fluorosilicate (Dry)

3. Water Plant Owner

MWSB - Manitoba Water Services Board
 PVWC - Pembina Valley Water Co-op
 RM - Rural Municipality

4. Water Source

SI - Surface Impoundment

NOTE: Population statistics are from 2006 census.

Water Plant Location	Status	Population	Ministerial Approval	Dates On-Line	Background Level	Chemical Feed	Average F mg/L	Water Source	Water Plant Owner
MANITOU	Town	718	64/01/21	65/05/13	0.19	NaF 4 %	1.0	SI	Town
MELITA	Town	1051	89/05/04	87/02/14	0.18	NaF 4 %	0.9	Well	Town
MINNEDOSA	Town	2474	60/01/25	86/04/01	0.28	H2SiF6 25 %	1.0	Well	Town
MORDEN	Town	6571	68/09/09	69/11/17	0.32	H2SiF6 25 %	0.8	Lake	Town
MORRIS	Region	1643	89/05/04	89/02/27	0.22	H2SiF6 25 %	1.0	River	PVWC
NEEPAWA	Town	3298	63/06/10	63/07/10	0.24	Na2SiF6 (Dry)	0.7	Lake	Town
PILOT MOUND	Town	630	68/10/25	70/12/21	0.21	NaF 4 %	0.7	SI	Town
PINAWA	LGD	1450	63/11/26	64/01/14	0.08	H2SiF6 25 %	0.9	River	LGD
PORTAGE LA PRAIRIE	City	12728	57/12/20	58/01/13	0.2	H2SiF6 25 %	0.9	River	City
RESTON	Village	N/A	67/09/13	68/11/26	0.13	NaF 4 %	1.0	Well	RM
RIVERS	Town	1193	68/06/07	86/10/27	0.18	NaF 4 %	0.9	Well	Town
ROBLIN	Town	1672	69/06/07	86/10/27	0.26	NaF 4 %	0.9	Well	Town
ROSSBURN	Town	546	89/05/04	77/12/05	0.1	NaF 4 %	0.8	Well	Town
RUSSELL	Town	1428	65/09/10	67/03/01	0.21	NaF 4 %	0.9	Well	Town
SANFORD (RM MACDONALD)	Region	5653	89/11/21	89/11/21	0.1	H2SiF6 25 %	0.9	River	RM
SAPOTAWAYAK	Reserve	N/A	03/12/18	03/12/18	0.31	NaF 4 %	0.8	River	Reserve
SHILO	CFB	N/A	69/01/14	69/01/14	0.05	NaF 4 %	0.9	Well	CFB
SOMERSET	Village	432	04/03/01	04/05/01	0.02	H2SiF6 25 %	0.8	Well	MSWB
SOURIS	Town	1772	62/07/11	63/11/05	0.19	NaF 4 %	1.0	River	Town
STEINBACH	City	11066	59/11/04	60/05/23	0.39	H2SiF6 25 %	0.8	Well	City
STEPHENFIELD	Region	N/A	98/12/01	99/02/01	0.2	H2SiF6 25 %	1.1	River	PVWC
SWAN RIVER	Town	3859	80/10/07	82/08/08	0.18	H2SiF6 25 %	1.0	Well	Town
THE PAS	Town	5589	64/07/20	64/07/23	0.15	H2SiF6 25 %	0.9	River	Town
TREHERNE	Town	646	72/11/10	73/06/11	0.32	Na2SiF6 (Dry)	0.9	Well	Town
VIRDEN	Town	3010	71/01/11	71/04/08	0.44	NaF 4 %	0.8	Well	Town

KEY:	2. Type of Chemical Feed	3. Water Plant Owner	4. Water Source
1. Status	H2SiF6 - Fluorosilicic Acid	MWSB - Manitoba Water Services Board	SI - Surface Impoundment
CFB - Canadian Forces Base	NaF - Sodium Fluoride	PVWC - Pembina Valley Water Co-op	
LGD - Local Government District	Na2SiF6 - Sodium Fluorosilicate (Dry)	RM - Rural Municipality	
UVD - Unincorporated Village District			

Summary

Communities with a Fluoridated Water Supply as of April 1, 2006

NOTE: Population statistics are from 2006 census.

Water Plant Location	Status	Population	Ministerial Approval	Dates On-Line	Background Level	Chemical Feed	Average F mg/L	Water Source	Water Plant Owner
WABOWDEN	Village	N/A	89/06/30	89/06/30	< 0.10	H2SiF6 25 %	1.0	Lake	UVD
WINKLER	City	9106	64/01/21	64/06/24	0.26	H2SiF6 25 %	0.8	Well	City
WINNIPEG	City	633451	56/07/20	56/12/28	0.1	H2SiF6 25 %	0.9	Lake	City
WINNIPEGOSIS	Village	628	89/05/04	88/08/10	0.15	NaF 4 %	0.9	Well	MSWB
*OTHER		1148***							

NOTES:

-The Red River Regional Water Treatment Plant in Letellier, Manitoba serves the following communities: Altona Rural Water Co-op, Dominion City, Gnadefeld, Gnadenthal, Gretna Halbstadt-Marais Water Co-op, Horndean, Neuberghthal, Plum Coulee, Rosenfeld, Roseau River Reserve, Sommerfeld, Town of Altona, Morden, Winkler and St. Jean

-The Regional Plant in Sanford also serves the communities of Brunkild, Domain, LaSalle, Oak Bluff and Starbuck

^ Cross Lake Community and Cross Lake Reserves combined have an approximate population of 4000.

* Cartier Regional provides water for several communities including Headingley, Elie, St. Eustache, St. Francis etc.

KEY:

1. Status

CFB - Canadian Forces Base
LGD - Local Government District
UVD - Unincorporated Village District

2. Type of Chemical Feed

H2SiF6 - Fluorosilicic Acid
NaF - Sodium Fluoride
Na2SiF6 - Sodium Fluorosilicate (Dry)

3. Water Plant Owner

MWSB - Manitoba Water Services Board
PVWC - Pembina Valley Water Co-op
RM - Rural Municipality

4. Water Source

SI - Surface Impoundment

II.FLUORIDATION GRANT

Each fiscal year, grant monies are available through Manitoba Health. The grant is a one time award to communities initiating a fluoridation system.

A.OVERVIEW

1)OBJECTIVE:

To have all communal water systems in the Province fluoridated.

2)ELIGIBILITY:

Any community with an existing water treatment plant that currently does not have an optimal fluoride level in the water supply is eligible.

3)DESCRIPTION:

If a community is interested in this grant, contact can be made with Manitoba Health. Manitoba Health will provide information on the grant program, make formal contact with the community and assist in the design, installation and operation of the equipment. Once the system is operational, payment will be authorized to the community for the initial purchase and installation of the equipment. Assistance is provided with ongoing monitoring of the fluoride levels in the water supply.

4) FUNDING:

The grant is based on actual initial costs of purchase and installation of equipment as submitted by communities.

5) MINISTERIAL APPROVAL:

Approval is issued by the Minister of Health to communities operating fluoridation systems in accordance with the regulations under the Manitoba Public Health Act.

B.NEW PARTICIPANTS AND UPGRADES

1) Negotiations are underway with several new Reserve Communities.

2) Several communities received small upgrade grants.

3) Norway House has plans to reconnect a system.

III. EQUIPMENT

Fluoridation systems are periodically monitored and reassessed for efficiency. Efforts are made to upgrade older equipment to more efficient systems.

A. OVERVIEW

Water treatment plants are visited on a periodic basis for the purpose of encouraging preventive maintenance of the fluoridation systems.

Ongoing assistance is provided to ensure that adequate maintenance and safety practices are being followed. Testing procedures are also reviewed to ensure accurate monitoring of fluoride levels.

B. FLUORIDATION SYSTEMS

There are four types of fluoridation systems available. They are as follows:

a) Acid Feed

This system utilizes fluorosilicic acid (H_2SiF_6) as the chemical feed.

b) Batch Mix

This system utilizes sodium fluoride (NaF) as the chemical feed. This system is labour intensive and communities utilizing this system are encouraged to upgrade to either an acid feed or an upflow saturator system.

c) Dry Feed

This system utilizes sodium fluorosilicate (Na_2SiF_6) as the chemical feed. These systems were designed and installed in the 1950's and 1960's for larger treatment facilities. All remaining are fully functional with few operating problems.

d) Upflow Saturator

This system utilizes sodium fluoride (NaF) in a 4% solution as the chemical feed.

C. OPERATING PROBLEMS

Temporary operating problems may occur from time to time and are usually related to one of the following:

- a) obsolete or malfunctioning fluoride feed equipment
- b) obsolete or defective testing equipment
- c) incorrect testing procedures
- d) equipment breakdown
- e) improper maintenance
- f) changeover to a new system

Occasionally, fluoridation problems are related to water plant problems which are rectified when the plant's problems are corrected.

IV. MONITORING PROGRAM

A. OVERVIEW

The purpose of this program is to ensure that the recommended level for fluoride concentration is maintained in Manitoba's drinking water. All operating systems participated in the monitoring program.

1) Operating Parameters

Manitoba Health identifies an operating range and an optimum level for fluoride concentration in drinking water. The optimum is 1 part per million (ppm) or 1 milligram per litre (mg/L). The operating range for 2006 / 2007 was set at 0.80 ppm as a minimum with 1.20 ppm as a maximum.

Water treatment plant operators are encouraged to maintain fluoride concentrations within the specified range.

Manitoba Health provides a schedule for bi-weekly monitoring periods. A sampling year consists of 26 periods.

2) Supplies

Manitoba Health provides Fluoridation Control Record forms to the plants, to be submitted with the samples. Manitoba Health also provides sampling bottles, fluoride standard solution, spadns (reagent) and shipping containers to the plants, through ALS Laboratory Group. All are necessary for daily testing and bi-weekly sample submission.

3) Sample Submission

Samples are collected on a daily basis, tested on-site and results are recorded by the water treatment plant operator. A 14 day composite sample (approximately one litre) is submitted bi-weekly by the community for analysis. A record of chemical feed data (Fluoridation Control Record) is submitted with the sample.

4) Analysis

ALS Laboratory Group, located in Winnipeg, receives the samples and conducts the analysis. The results are reported to the individual water treatment plant operators and to Manitoba Health.

5) Monitoring

Manitoba Health monitors the levels, makes recommendations, and provides technical assistance accordingly.

6) Reporting

Communities receive an annual report of their plant's operating record. On a periodic and/or as required basis, reports are provided during the operating year.

B. RESULTS

In 2006 / 2007, out of a possible 1,404 samples, 1,354 bi-weekly samples were received for a submission rate of 96.4%.

Of the total submitted 1,115 or 82.3% were within the recommended range for fluoride concentration.

The number of samples found to be above the range was 39, representing 2.8% of the total.

There were 200 samples found to be below the range representing 14.8% of all samples submitted.

Samples of .7 ppm will be acceptable for purposes of certificate eligibility.

Bi-Weekly Sampling Results Summary 2006 / 2007

Table 2

Town	No. of Samples Within Limits	No. of Samples Above Limits	No. of Samples Below Limits	No. of Samples Submitted	No. of Samples Possible
AUSTIN	21	2	3	26	26
BALDUR	24	0	2	26	26
BENITO	26	0	0	26	26
BINSCARTH	18	0	8	26	26
BIRTLE	19	3	3	25	26
BOISSEVAIN	26	0	0	26	26
BRANDON	22	0	4	26	26
CARMAN	12	0	14	26	26
CARTIER REGIONAL	19	0	7	26	26
CHURCHILL	22	0	4	26	26
CRANBERRY PORTAGE	26	0	0	26	26
CROSS LAKE RESERVE	24	2	0	26	26
DAUPHIN	26	0	0	26	26
DELORAIN	26	0	0	26	26
FLIN FLON	26	0	0	26	26
GILBERT PLAINS	15	0	11	26	26
GILLAM	26	0	0	26	26
GIMLI INDUSTRIAL PARK	24	0	2	26	26
GLADSTONE	14	0	1	15	26
GRISWOLD SIOUX VALLEY BAND	3	0	12	15	26
HAMIOTA	23	2	1	26	26
HARTNEY	19	5	2	26	26
KILLARNEY	16	4	6	26	26
LETELLIER-RRRWTP	26	0	0	26	26
LONG PLAIN	12	2	12	26	26
MANITOU	26	0	0	26	26
MELITA	22	0	4	26	26
MINNEDOSA	21	3	1	25	26
MORDEN	24	0	2	26	26
MORRIS	25	1	0	26	26
NEEPAWA	11	0	15	26	26
PILOT MOUND	10	0	16	26	26
PINAWA	6	0	1	7	26
PORTAGE LA PRAIRIE	26	0	0	26	26
RESTON	18	2	6	26	26
RIVERS	21	0	5	26	26
ROBLIN	25	0	1	26	26
ROSSBURN	20	0	6	26	26
RUSSELL	26	0	0	26	26
SANFORD (RM MACDONALD)	23	0	3	26	26
SAPOTAWAYAK	13	0	11	24	26
SHILO	19	1	3	23	26
SOMERSET	5	5	16	26	26
SOURIS	24	0	2	26	26
STEINBACH	22	0	4	26	26
STEPHENFIELD	22	4	0	26	26
SWAN RIVER	25	0	1	26	26
THE PAS	25	0	1	26	26
TREHERNE	26	0	0	26	26
VIRDEN	23	0	3	26	26
WABOWDEN	21	3	2	26	26
WINKLER	22	0	4	26	26
WINNIPEG	23	0	1	24	26
WINNIPEGOSIS	26	0	0	26	26

C. CERTIFICATES

Manitoba Health annually presents certificates to recognize water treatment plant operators who have maintained a high standard of operating efficiency for a fluoridation system.

To be eligible for a certificate, a plant must be participating for 50% of the sampling year.

For the 2006 / 2007 sampling year this represented 26 periods.

There were 53 plants eligible for the certificates in 2006 / 2007. The Altona plant is not eligible for the certificate program because it is a sampling location only.

1) CERTIFICATE OF EXCELLENCE

The selection criteria are:

- A) 100% of bi-weekly samples must be submitted for the sampling year and
- B) 100% of submitted samples must be within the recommended operating range for fluoride concentration

In 2006 / 2007 certificates of excellence were presented to 26 water plant supervisors/operators. This represents 49% of the total number of eligible community fluoridation systems. Allowances are made on the presentation of certificates when justifiable explanations are provided.

2) CERTIFICATE OF COMMENDATION

The selection criteria are:

- A) 85% or 22 out of 26 bi-weekly samples must be submitted for the sampling year, and
- B) 90% of submitted samples must be within the recommended operating range for fluoride concentration.

In 2006 / 2007 certificates of commendation were presented to 15 water plant supervisors/operators. This represents 28% of the total number of eligible community fluoridation systems. Allowances are made on the presentation of certificates when justifiable explanations are provided. Occasional readings of .7 ppm are considered acceptable for certificate eligibility.

The total number of certificates presented was 42 out of a possible 53. Thus, 79% of the operators/supervisors were awarded with recognition certificates.

Certificates of Excellence

2006 / 2007 Recipients

Recipient	Plant Location	Operating Authority
Raymond Lussier	BALDUR	Rural Municipality
Rick Kinaschuk	BENITO	Village
Barry Chinner	BOISSEVAIN	Town
Darcy Rajczakowski	CRANBERRY PORTAGE	Rural Municipality
Bill Brenner	DAUPHIN	Town
Kent Corkish	DELORAINE	Town
Kevin Komarnicki	FLIN FLON	City
John McDonald	GILLAM	Local Government District
Richard Bezdietny	GIMLI INDUSTRIAL PARK	Town
Kurt Henry	LETELLIER-RRRWTP	PVWC
Bob Barett	MANITOU	Town
Al Spearman	MORDEN	Town
Richard Dupuis	MORRIS	PVWC
Doug Campbell	PORTAGE LA PRAIRIE	City
Don Todorovich	ROBLIN	Town
Mark Moan	RUSSELL	Town
David Eppler	SANFORD (RM MACDONALD)	Rural Municipality
Don Bodin and Kelvin Kowalchuk	SOURIS	Town
Jason Hiebert	STEINBACH	City
Eric Arp	SWAN RIVER	Town
Ronald Stewart	THE PAS	Town
Ken Lawrence	TREHERNE	Town
Norm Baxter	VIRDEN	Town
Travis Duff	WINKLER	City
Frank DeVries	WINNIPEG	City
Dan Rempel	WINNIPEGOSIS	MSWB

Certificates of Commendation

2006 / 2007 Recipients

Recipient	Plant Location	Operating Authority
Ed Sattler	AUSTIN	RM
Steve Stewart	BINSCARTH	Village
Brad McIntosh	BRANDON	City
Dave Pirt	CARTIER REGIONAL	Private
William Ayotte	CHURCH LL	Local Government District
Lawrence McLeod	CROSS LAKE RESERVE	Reserve
Ken Curie	HAMIOTA	Town
Bob Reddaway	MELITA	Town
Frank Taylor	MINNEDOSA	Town
Ron Forbes	PILOT MOUND	Town
Randy King	RIVERS	Town
Perry Kretai	ROSSBURN	Town
Bill Burke	SHILO	CFB
Paul Termer	STEPHENFIELD	PVWC
Clarence Bayer	WABOWDEN	UVD

V. Manitoba Water Services Board

Manitoba Water Services Board owns a number of treatment facilities across Manitoba and provides water to communities.

In communities currently fluoridating, Manitoba Water Services Board works cooperatively with Manitoba Health to ensure that the requirements of the fluoridation monitoring system are met.

In communities wishing to fluoridate, Manitoba Water Services Board works in conjunction with Manitoba Health to assess the water treatment facility design the fluoridation system and coordinate installation and start-up.

Manitoba Water Services Board plant operators are trained by Manitoba Health staff in proper testing, operating and maintenance procedures for their specific fluoridation systems.

VI. SUPPORT SERVICES

Manitoba Health wishes to acknowledge the support received from various groups and government departments which provided assistance with the performance of the Community Water Fluoridation Program:

- i. Mayors, Community Councils, Waterworks Chairpersons, Band Councils, and especially water treatment plant operators and supervisors in all locations with community water fluoridation systems in operation.
- ii. Manitoba Water Services Board for the cooperative efforts made to ensure Manitoba Health standards were observed in all fluoridating locations.
- iii. ALS Laboratory Group for the provision of fluoride level analyses, the distribution of reagents, sample bottles and fluoride results to participating communities, the preparation of this report and other administrative services.
- iv. Manitoba Water Stewardship for the provision of inspection and surveillance services in water plants, as well as consultation services.
- v. Medical Services Branch, Health Canada for the promotion of fluoridation on Manitoba First Nation communities.
- vi. Equipment manufacturers and suppliers for assistance with system design, especially Prairie Chem Inc. for promotion services and consultation assistance.

All of the above individuals and agencies have been instrumental in the provision of this important preventive dental health measure to the citizens of Manitoba.

A special thank you to Helen Browne, administrative assistant, without whom this program would not run so well!

FOR FURTHER INFORMATION REGARDING MANITOBA'S COMMUNITY
WATER FLUORIDATION PROGRAM PLEASE CONTACT:

Manitoba Health
Public Health Branch
300 Carlton Street
Winnipeg MB R3B 3M9

Telephone: (204) 788-6735
Fax: (204) 948-2040
Email: Helen.Browne@gov.mb.ca

VII
FLUORIDE
CONTROL
DATA
2006 / 2007

Manitoba Health Fluoride Monitoring Program

Table 3

Fluoride Control Data Laboratory Results - 2006 / 2007 - Summary

The figures in this table reflect results of the testing of bi-weekly composite samples for fluoride concentration in parts per million

Location / Period Number	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26
AUSTIN	1.0	1.1	1.0	0.9	1.1	1.2	1.3	1.4	0.9	1.0	0.9	1.0	1.0	1.0	0.8	0.8	0.8	0.8	0.7	0.7	0.7	1.0	0.9	1.0	0.8	1.0
BALDUR	0.9	0.8	0.8	0.8	0.9	0.8	1.0	0.9	0.8	0.8	0.7	1.0	0.9	1.0	0.9	0.8	0.8	0.8	0.8	0.8	0.9	1.0	0.7	0.9	0.8	0.9
BENITO	0.9	0.9	1.0	1.0	0.9	1.0	1.2	1.2	1.2	1.0	1.0	1.1	1.1	1.1	1.0	1.0	1.0	0.9	0.9	0.9	1.0	1.0	0.9	1.0	0.8	0.8
BINSCARTH	0.9	0.9	0.8	0.9	0.9	1.0	1.1	0.7	1.0	1.0	0.9	0.7	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.7	0.7	1.0	1.0	0.8	0.8	0.9
BIRTLE	0.3	0.7	1.0	1.1	1.4	1.3	1.2	1.2	1.1	1.1	1.0	1.1	1.2	1.4	1.1	1.1	1.0	1.1	1.1	1.0	0.8	1.0	0.9	0.9	0.3	
BOISSEVAIN	0.9	0.9	0.9	1.0	0.9	0.9	1.0	0.9	1.0	0.9	0.9	1.0	0.9	1.1	0.8	0.8	1.0	0.9	0.9	0.8	0.9	1.0	0.9	0.9	0.8	1.0
BRANDON	0.9	0.6	0.8	1.0	1.1	1.0	1.1	1.1	0.9	0.9	0.7	0.9	0.8	1.0	0.7	0.7	0.7	0.9	0.8	0.8	0.9	1.0	1.0	0.9	0.8	1.0
CARMAN	0.7	0.7	0.7	0.7	0.7	0.8	0.9	0.7	0.8	0.8	0.7	1.0	1.1	1.1	0.6	0.5	0.6	0.6	0.6	0.7	0.8	1.0	1.0	0.8	0.7	1.0
CARTIER REGIONAL	0.9	0.9	0.9	0.9	1.0	1.1	1.1	1.0	1.0	1.0	1.0	1.0	1.1	1.0	1.1	1.0	0.9	0.8	0.7	0.6	0.6	0.7	0.7	0.7	0.7	0.8
CHURCHILL	0.9	0.8	0.8	0.9	0.9	0.8	1.0	1.1	1.0	1.0	0.8	1.0	0.8	0.9	0.8	0.7	0.7	0.7	0.7	0.9	0.8	1.0	1.0	1.0	0.8	1.0
CRANBERRY PORTAGE	1.2	1.1	1.0	1.2	1.0	1.1	0.9	1.0	1.0	1.0	1.1	1.1	1.0	1.0	1.0	1.0	1.0	1.0	0.9	1.2	1.0	1.1	1.0	1.1	1.0	1.2
CROSS LAKE RESERVE	1.1	1.1	0.9	1.4	1.7	1.1	1.1	1.1	0.9	1.2	1.0	1.0	1.2	1.1	1.0	0.8	1.2	1.1	1.0	1.0	1.0	1.0	1.0	0.9	1.0	0.9
DAUPHIN	1.0	1.0	1.0	1.1	1.1	0.9	1.0	1.1	1.0	1.0	1.0	1.1	1.0	1.1	1.0	0.9	1.0	0.9	0.9	0.9	1.0	1.0	1.0	0.9	0.9	1.1
DELORAINE	1.0	1.0	1.0	0.9	0.9	0.9	0.9	0.8	0.9	0.8	0.9	0.9	0.9	1.1	0.8	0.8	0.8	0.9	0.9	0.9	0.9	1.0	0.9	0.8	0.9	1.0
FLIN FLON	1.1	0.9	0.9	1.1	1.0	0.9	1.1	1.2	1.0	1.0	0.9	1.0	1.0	0.9	0.9	0.9	1.0	0.9	0.9	0.9	1.0	1.0	0.9	1.0	1.0	1.1
GILBERT PLAINS	0.6	0.4	0.8	0.9	1.1	0.9	0.7	0.7	0.6	0.8	0.4	0.7	0.8	1.0	0.7	0.6	1.0	0.9	0.9	0.9	0.8	0.6	0.5	1.0	0.9	0.8
GILLAM	1.1	1.0	1.1	1.0	0.9	1.1	0.9	0.9	0.9	1.1	1.1	1.2	1.1	1.0	0.9	1.0	1.1	0.9	0.9	0.9	1.0	1.0	0.9	1.0	1.0	1.1
GIMLI INDUSTRIAL PARK	0.9	1.0	0.9	0.9	0.9	1.0	1.1	0.7	1.0	1.0	1.0	0.9	0.9	1.1	1.0	0.9	0.8	0.7	0.8	0.9	0.9	1.0	0.9	0.9	0.8	1.0
GLADSTONE	0.9	0.9	1.0	0.8	0.9	1.0	1.0	1.0	0.9	0.9	0.9	0.9	0.8	1.0	0.2											
GRISWOLD SIOUX VALLEY BAND		0.7	0.6	0.6	0.7	0.7	0.9	0.5	0.7	0.7	0.7	0.5			0.9	1.0	0.7	0.7								
HAMIOTA	1.2	0.9	0.8	1.3	1.2	1.1	1.2	1.3	1.2	1.1	1.1	1.2	1.1	1.1	1.0	0.9	1.0	0.9	1.0	1.1	1.2	1.0	1.2	1.1	1.0	0.6
HARTNEY	1.0	0.9	0.9	0.9	1.0	1.0	1.1	1.0	0.9	0.9	0.8	0.9	0.8	1.0	0.7	0.5	1.1	0.8	1.1	1.1	1.1	2.0	5.9	4.8	1.9	2.5
KILLARNEY	1.1	1.1	0.9	1.0	1.2	0.9	1.1	1.0	0.9	0.6	0.5	0.6	0.5	1.0	0.3	1.2	1.0	1.3	1.2	0.3	1.1	1.3	1.0	1.5	0.8	1.4
LETELLIER-RRRWTP	1.1	1.1	1.0	1.0	1.0	0.9	1.1	1.1	1.0	1.0	1.0	1.1	1.0	1.1	1.0	1.0	1.0	1.0	1.0	1.0	1.1	1.0	1.0	1.1	0.9	1.1
LONG PLAIN	0.7	0.8	0.6	0.7	0.9	0.8	0.9	1.1	1.0	0.8	0.7	0.7	0.9	1.0	0.6	0.6	0.6	0.6	0.7	0.7	0.9	0.9	0.7	1.1	1.4	1.4
MANITOU	1.0	1.0	1.0	1.0	1.1	1.0	1.1	1.1	1.0	0.9	1.1	1.0	1.0	1.1	0.9	0.9	1.0	1.0	0.9	1.0	1.1	0.9	1.0	0.9	0.9	1.1
MELITA	0.9	0.9	0.9	0.4	0.7	0.9	1.0	0.9	0.9	1.1	1.0	1.0	0.9	1.0	0.8	0.8	0.6	0.6	0.9	1.0	1.0	1.0	1.0	0.9	0.8	1.1
MINNEDOSA	0.8	0.9	0.9	0.9	0.9	1.8		2.5	0.8	0.8	0.8	0.8	0.8	1.0	0.8	0.8	0.7	0.8	0.8	0.9	0.9	1.0	0.9	2.0	1.0	0.9
MORDEN	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.9	0.9	0.8	0.8	1.0	1.1	0.8	0.9	1.0	0.9	0.8	0.8	0.8	1.0	0.8	0.8	0.7	0.9
MORRIS	1.0	1.1	1.0	1.0	1.0	0.9	0.9	0.9	1.0	0.9	0.9	1.0	0.9	1.1	0.9	0.8	1.0	0.9	0.8	1.0	1.1	1.0	1.0	1.0	1.0	1.3
NEEPAWA	0.6	0.7	0.7	0.8	0.6	0.7	0.5	0.7	0.9	0.6	0.5	0.8	0.7	1.0	0.7	0.7	0.8	0.5	0.8	0.8	0.8	0.5	0.9	0.7	0.8	0.8

Manitoba Health Fluoride Monitoring Program

Table 3

Fluoride Control Data Laboratory Results - 2006 / 2007 - Summary

The figures in this table reflect results of the testing of bi-weekly composite samples for fluoride concentration in parts per million

Location / Period Number	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26
PILOT MOUND	0.6	0.8	0.7	0.8	0.8	0.7	1.0	0.8	0.9	0.8	1.0	0.8	0.7	1.0	0.7	0.7	0.7	0.6	0.6	0.7	0.6	0.6	0.6	0.6	0.7	0.7
PINAWA	0.9	0.7	0.8	0.9	1.0	0.9	0.9																			
PORTAGE LA PRAIRIE	0.8	0.9	0.8	0.9	1.0	1.1	1.2	1.1	1.0	1.0	0.9	1.0	1.0	0.9	0.8	0.8	0.9	0.9	0.9	0.8	1.0	1.0	0.8	0.8	0.8	0.8
RESTON	1.2	1.1	0.9	1.2	1.1	0.6	0.4	0.1	0.4	0.4	0.3	1.1	1.0	1.0	0.9	0.9	0.8	1.0	1.0	2.6	2.3	1.0	0.9	0.8	0.8	1.0
RIVERS	1.1	0.9	0.5	1.0	0.9	1.0	1.0	1.0	0.9	0.8	1.0	0.7	1.0	1.0	0.9	0.8	0.8	0.6	0.8	0.8	0.8	0.6	0.8	0.8	0.7	0.9
ROBLIN	0.9	1.0	0.9	0.9	1.0	0.9	0.9	0.9	1.0	1.0	0.9	1.0	0.9	1.0	0.9	0.9	0.9	0.8	0.8	0.8	0.9	1.0	0.8	0.8	0.7	0.9
ROSSBURN	0.9	0.9	0.7	0.6	0.8	0.8	1.2	0.9	1.0	0.9	0.8	1.1	0.9	1.1	0.8	0.7	0.5	0.5	0.8	0.8	0.8	1.0	0.8	0.8	0.7	1.0
RUSSELL	1.0	1.0	0.9	1.0	1.0	0.8	0.8	0.8	0.9	0.9	0.9	1.2	0.8	1.1	0.9	0.8	1.1	0.8	0.8	0.8	0.8	1.0	0.9	1.0	0.8	1.1
SANFORD (RM MACDONALD)	0.8	0.7	0.9	0.9	0.9	0.8	0.9	0.7	0.7	0.9	0.8	0.8	0.9	1.1	0.8	0.8	1.1	0.8	0.8	0.8	0.9	1.0	0.9	0.8	0.8	1.0
SAPOTAWAYAK	0.6	0.8	1.0	0.9	1.0	1.0	1.0	1.0	0.8	0.8	0.7	0.7	0.8	0.7	0.7	0.6	0.6	1.0	1.0	0.7	0.7	0.7			0.6	0.8
SHILO	1.1	1.0	0.9	1.0	1.0	0.9	1.1	1.3	1.0	0.9	1.1	1.1	1.0	1.0	0.6		1.0	0.8	1.0	0.9	0.6	0.9		0.8	0.6	
SOMERSET	0.7	0.7	0.5	0.5	0.6	0.6	0.6	0.4	0.6	0.6	0.5	0.7	0.6	0.6	0.6	0.5	1.0	0.8	0.8	1.3	1.7	1.6	1.6	1.2	1.1	1.4
SOURIS	1.0	0.9	0.7	1.0	1.0	0.8	1.0	1.2	0.8	1.1	1.1	1.0	1.0	1.0	1.2	0.9	1.0	1.0	0.9	0.7	0.8	0.8	0.9	1.0	1.0	0.9
STEINBACH	0.8	0.8	0.8	0.7	0.8	0.8	0.8	0.8	0.8	0.8	1.0	0.9	0.8	0.9	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.7	0.8	0.7	0.9
STEPHENFIELD	1.2	1.2	1.2	1.1	1.1	1.1	1.3	1.4	1.5	1.2	1.2	1.3	1.1	1.0	0.9	0.9	1.0	0.8	0.8	0.8	0.9	1.0	1.0	1.1	1.0	1.2
SWAN RIVER	1.0	1.0	1.0	1.0	1.0	0.9	1.1	1.1	1.1	1.0	0.9	1.1	0.9	1.1	0.9	0.9	0.7	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0	1.2
THE PAS	0.9	0.9	0.8	0.9	0.9	0.8	0.9	0.7	0.8	0.9	0.8	1.0	0.9	1.0	0.9	0.9	1.0	1.0	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.1
TREHERNE	0.9	1.0	0.9	0.9	1.0	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9	1.0	0.9	0.8	1.0	0.9	0.9	1.0	0.9	1.0	0.9	0.8	0.8	1.0
VIRDEN	0.8	0.9	0.8	0.8	0.7	0.9	0.9	1.0	0.9	0.9	0.7	0.9	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.9	0.8	1.0	1.0	0.8	0.8	0.9
WABOWDEN	0.7	1.0	1.2	0.8	0.9	1.1	1.3	1.2	1.3	1.1	0.8	1.0	1.3	0.9	0.8	0.7	1.0	1.0	1.0	1.0	1.1	1.0	1.1	1.0	1.0	0.9
WINKLER	0.9	0.7	0.8	0.8	0.8	0.7	0.8	0.8	0.7	0.8	0.8	0.9	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.0	0.9	0.7	0.8
WINNIPEG	0.9	0.9	1.0			0.9	1.0	0.9	0.9	0.9	0.8	0.9	1.0	0.9	0.8	0.8	1.0	0.8	0.8	0.8	0.9	0.8	1.0	0.8	0.8	0.7
WINNIPEGOSIS	0.8	0.9	0.9	0.9	0.9	0.9	1.0	0.9	0.9	0.9	0.9	1.0	0.9	1.0	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.0	1.0	0.9	1.1

FLUORIDATION CONTROL DATA - KEY

All figures reported are recorded in parts per million (ppm) or milligrams per litre (mg/L).

COMPOSITE (LAB)

Fluoride level analysis conducted by ALS Laboratory Group on the bi-weekly composite sample submitted by the water plant operator.

COMPOSITE (OPERATOR)

Fluoride level analysis conducted and reported by the water treatment plant operator on the bi-weekly sample before it is submitted to ALS Laboratory Group.

NOTE: If "NOT AVAILABLE" appears in any column, it indicates that data is not available due to one of the following reasons:

- sample not submitted
- sample broken in transit
- information not provided
- sample was contaminated

Fluoride Control Data 2006 / 2007

LOCATION AUSTIN	FLUORIDATOR	LMI A151
OPERATOR Ed Sattler	CHEMICAL	Na2SiF6 (Dry)
PHONE 637-2461	NATURAL FLUORIDE	0.19

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.0	1.05
2 APR 1 - APR 14	1.1	0.96
3 APR 15 - APR 28	1.0	0.79
4 APR 29 - MAY 12	0.9	1.07
5 MAY 13 - MAY 28	1.1	0.90
6 MAY 29 - JUN 9	1.2	1.16
7 JUN 10 - JUN 23	1.3	1.19
8 JUN 24 - JUL 7	1.4	1.18
9 JUL 8 - JUL 21	0.9	0.94
10 JUL 22 - AUG 4	1.0	1.00
11 AUG 5 - AUG 18	0.9	1.05
12 AUG 19 - SEP 1	1.0	1.00
13 SEP 2 - SEP 15	1.0	1.02
14 SEP 16 - SEP 29	1.0	1.10
15 SEP 30 - OCT 13	0.8	0.88
16 OCT 14 - OCT 27	0.8	0.87
17 OCT 28 - NOV 10	0.8	NOT AVAILABLE
18 NOV 11 - NOV 24	0.8	0.99
19 NOV 25 - DEC 8	0.7	1.12
20 DEC 9 - DEC 22	0.7	1.13
21 DEC 23 - JAN 5	0.7	0.92
22 JAN 6 - JAN 19	1.0	1.15
23 JAN 20 - FEB 2	0.9	0.92
24 FEB 3 - FEB 16	1.0	0.95
25 FEB 17 - MAR 2	0.8	0.87
26 MAR 3 - MAR 16	1.0	1.19

Summary for AUSTIN

Average	1.0	1.02
Minimum	0.7	0.79
Maximum	1.4	1.19
Samples Above Limit	2	
Samples Below Limits	3	
% Outside Limits:	19%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	BALDUR	FLUORIDATOR	LMI A151
OPERATOR	Raymond Lussier	CHEMICAL	NaF 4 %
PHONE	535-2176	NATURAL FLUORIDE	0.22

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	0.89
2	APR 1 - APR 14	0.8	0.84
3	APR 15 - APR 28	0.8	0.88
4	APR 29 - MAY 12	0.8	0.87
5	MAY 13 - MAY 28	0.9	0.89
6	MAY 29 - JUN 9	0.8	0.85
7	JUN 10 - JUN 23	1.0	0.97
8	JUN 24 - JUL 7	0.9	0.86
9	JUL 8 - JUL 21	0.8	0.85
10	JUL 22 - AUG 4	0.8	0.82
11	AUG 5 - AUG 18	0.7	0.80
12	AUG 19 - SEP 1	1.0	0.89
13	SEP 2 - SEP 15	0.9	0.88
14	SEP 16 - SEP 29	1.0	0.84
15	SEP 30 - OCT 13	0.9	0.83
16	OCT 14 - OCT 27	0.8	0.91
17	OCT 28 - NOV 10	0.8	0.83
18	NOV 11 - NOV 24	0.8	0.81
19	NOV 25 - DEC 8	0.8	0.85
20	DEC 9 - DEC 22	0.8	0.83
21	DEC 23 - JAN 5	0.9	0.72
22	JAN 6 - JAN 19	1.0	0.85
23	JAN 20 - FEB 2	0.7	0.82
24	FEB 3 - FEB 16	0.9	0.85
25	FEB 17 - MAR 2	0.8	0.78
26	MAR 3 - MAR 16	0.9	0.83

Summary for BALDUR

Average	0.9	0.85
Minimum	0.7	0.72
Maximum	1.0	0.97
Samples Above Limit	0	
Samples Below Limits	2	
% Outside Limits:	8%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION BENITO	FLUORIDATOR	LMI A151
OPERATOR Rick Kinaschuk	CHEMICAL	NaF 4 %
PHONE 539-2634	NATURAL FLUORIDE	0.3

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	0.90
2	APR 1 - APR 14	0.9	0.90
3	APR 15 - APR 28	1.0	1.10
4	APR 29 - MAY 12	1.0	1.00
5	MAY 13 - MAY 28	0.9	1.00
6	MAY 29 - JUN 9	1.0	1.00
7	JUN 10 - JUN 23	1.2	1.00
8	JUN 24 - JUL 7	1.2	1.00
9	JUL 8 - JUL 21	1.2	1.10
10	JUL 22 - AUG 4	1.0	1.10
11	AUG 5 - AUG 18	1.0	1.00
12	AUG 19 - SEP 1	1.1	0.90
13	SEP 2 - SEP 15	1.1	1.00
14	SEP 16 - SEP 29	1.1	1.10
15	SEP 30 - OCT 13	1.0	1.01
16	OCT 14 - OCT 27	1.0	1.10
17	OCT 28 - NOV 10	1.0	1.10
18	NOV 11 - NOV 24	0.9	1.10
19	NOV 25 - DEC 8	0.9	1.10
20	DEC 9 - DEC 22	0.9	1.10
21	DEC 23 - JAN 5	1.0	1.10
22	JAN 6 - JAN 19	1.0	1.00
23	JAN 20 - FEB 2	0.9	0.90
24	FEB 3 - FEB 16	1.0	1.00
25	FEB 17 - MAR 2	0.8	0.90
26	MAR 3 - MAR 16	0.8	0.90

Summary for BENITO

Average	1.0	1.02
Minimum	0.8	0.90
Maximum	1.2	1.10
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	BINSCARTH	FLUORIDATOR	Prom Gamma
OPERATOR	Steve Stewart	CHEMICAL	H2SiF6 25 %
PHONE	532-2223	NATURAL FLUORIDE	0.24

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	0.91
2	APR 1 - APR 14	0.9	1.07
3	APR 15 - APR 28	0.8	1.14
4	APR 29 - MAY 12	0.9	1.15
5	MAY 13 - MAY 28	0.9	1.15
6	MAY 29 - JUN 9	1.0	1.19
7	JUN 10 - JUN 23	1.1	1.04
8	JUN 24 - JUL 7	0.7	0.99
9	JUL 8 - JUL 21	1.0	1.13
10	JUL 22 - AUG 4	1.0	1.08
11	AUG 5 - AUG 18	0.9	1.00
12	AUG 19 - SEP 1	0.7	1.17
13	SEP 2 - SEP 15	0.8	1.01
14	SEP 16 - SEP 29	0.8	1.12
15	SEP 30 - OCT 13	0.8	1.16
16	OCT 14 - OCT 27	0.7	1.02
17	OCT 28 - NOV 10	0.7	0.83
18	NOV 11 - NOV 24	0.7	1.13
19	NOV 25 - DEC 8	0.7	1.01
20	DEC 9 - DEC 22	0.7	0.90
21	DEC 23 - JAN 5	0.7	1.04
22	JAN 6 - JAN 19	1.0	1.11
23	JAN 20 - FEB 2	1.0	1.11
24	FEB 3 - FEB 16	0.8	1.06
25	FEB 17 - MAR 2	0.8	0.93
26	MAR 3 - MAR 16	0.9	1.12

Summary for BINSCARTH

Average	0.8	1.06
Minimum	0.7	0.83
Maximum	1.1	1.19
Samples Above Limit	0	
Samples Below Limits	8	
% Outside Limits:	31%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	BIRTLE	FLUORIDATOR	LMI A741
OPERATOR	Darwin Fleury	CHEMICAL	NaF 4 %
PHONE	842-3234	NATURAL FLUORIDE	0.26

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.3	0.90
2	APR 1 - APR 14	0.7	1.19
3	APR 15 - APR 28	1.0	1.70
4	APR 29 - MAY 12	1.1	1.70
5	MAY 13 - MAY 28	1.4	1.60
6	MAY 29 - JUN 9	1.3	1.60
7	JUN 10 - JUN 23	1.2	1.42
8	JUN 24 - JUL 7	1.2	1.60
9	JUL 8 - JUL 21	1.1	1.50
10	JUL 22 - AUG 4	1.1	1.70
11	AUG 5 - AUG 18	1.0	1.40
12	AUG 19 - SEP 1	1.1	1.40
13	SEP 2 - SEP 15	1.2	1.50
14	SEP 16 - SEP 29	1.4	1.50
15	SEP 30 - OCT 13	1.1	1.50
16	OCT 14 - OCT 27	1.1	1.20
17	OCT 28 - NOV 10	1.0	1.80
18	NOV 11 - NOV 24	1.1	1.30
19	NOV 25 - DEC 8	1.1	1.40
20	DEC 9 - DEC 22	1.0	1.40
21	DEC 23 - JAN 5	0.8	1.20
22	JAN 6 - JAN 19	1.0	1.30
23	JAN 20 - FEB 2	0.9	1.20
24	FEB 3 - FEB 16	0.9	1.40
25	FEB 17 - MAR 2	0.3	1.40
26	MAR 3 - MAR 16	NOT AVAILABLE	NOT AVAILABLE

Summary for BIRTLE

Average	1.0	1.43
Minimum	0.3	0.90
Maximum	1.4	1.80
Samples Above Limit	3	
Samples Below Limits	3	
% Outside Limits:	24%	
Number of Samples	25	

Fluoride Control Data 2006 / 2007

LOCATION BOISSEVAIN
 OPERATOR Barry Chinner
 PHONE 534-2433

FLUORIDATOR
 CHEMICAL
 NATURAL FLUORIDE 0.2
 Precision
 NaF 4 %

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	1.33
2	APR 1 - APR 14	0.9	1.34
3	APR 15 - APR 28	0.9	1.22
4	APR 29 - MAY 12	1.0	1.21
5	MAY 13 - MAY 28	0.9	1.28
6	MAY 29 - JUN 9	0.9	1.23
7	JUN 10 - JUN 23	1.0	1.21
8	JUN 24 - JUL 7	0.9	1.24
9	JUL 8 - JUL 21	1.0	1.12
10	JUL 22 - AUG 4	0.9	1.12
11	AUG 5 - AUG 18	0.9	1.23
12	AUG 19 - SEP 1	1.0	1.26
13	SEP 2 - SEP 15	0.9	1.22
14	SEP 16 - SEP 29	1.1	1.24
15	SEP 30 - OCT 13	0.8	1.11
16	OCT 14 - OCT 27	0.8	1.09
17	OCT 28 - NOV 10	1.0	1.23
18	NOV 11 - NOV 24	0.9	1.23
19	NOV 25 - DEC 8	0.9	1.16
20	DEC 9 - DEC 22	0.8	1.17
21	DEC 23 - JAN 5	0.9	1.25
22	JAN 6 - JAN 19	1.0	1.25
23	JAN 20 - FEB 2	0.9	1.10
24	FEB 3 - FEB 16	0.9	1.10
25	FEB 17 - MAR 2	0.8	1.00
26	MAR 3 - MAR 16	1.0	1.14

Summary for BOISSEVAIN

Average	0.9	1.20
Minimum	0.8	1.00
Maximum	1.1	1.34
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	BRANDON	FLUORIDATOR	W&T A690
OPERATOR	Brad McIntosh	CHEMICAL	Na2SiF6 (Dry)
PHONE	729-2190	NATURAL FLUORIDE	0.2

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.9	1.04
2 APR 1 - APR 14	0.8	1.26
3 APR 15 - APR 28	0.8	1.14
4 APR 29 - MAY 12	1.0	1.11
5 MAY 13 - MAY 28	1.1	1.06
6 MAY 29 - JUN 9	1.0	1.16
7 JUN 10 - JUN 23	1.1	1.21
8 JUN 24 - JUL 7	1.1	1.22
9 JUL 8 - JUL 21	0.9	1.30
10 JUL 22 - AUG 4	0.9	1.29
11 AUG 5 - AUG 18	0.7	1.08
12 AUG 19 - SEP 1	0.9	1.33
13 SEP 2 - SEP 15	0.8	1.15
14 SEP 16 - SEP 29	1.0	1.04
15 SEP 30 - OCT 13	0.7	1.02
16 OCT 14 - OCT 27	0.7	1.19
17 OCT 28 - NOV 10	0.7	1.02
18 NOV 11 - NOV 24	0.9	1.32
19 NOV 25 - DEC 8	0.8	1.20
20 DEC 9 - DEC 22	0.8	1.26
21 DEC 23 - JAN 5	0.9	1.23
22 JAN 6 - JAN 19	1.0	1.22
23 JAN 20 - FEB 2	1.0	1.29
24 FEB 3 - FEB 16	0.9	1.20
25 FEB 17 - MAR 2	0.8	1.38
26 MAR 3 - MAR 16	1.0	1.06

Summary for BRANDON

Average	0.9	1.18
Minimum	0.7	1.02
Maximum	1.1	1.38
Samples Above Limit	0	
Samples Below Limits	4	
% Outside Limits:	15%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	CARMAN	FLUORIDATOR	W&T 47-050
OPERATOR	Bob Lambert	CHEMICAL	H2SiF6 25 %
PHONE	745-2481	NATURAL FLUORIDE	0.21

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.7	0.98
2	APR 1 - APR 14	0.7	1.07
3	APR 15 - APR 28	0.7	1.06
4	APR 29 - MAY 12	0.7	1.03
5	MAY 13 - MAY 28	0.7	1.04
6	MAY 29 - JUN 9	0.8	1.02
7	JUN 10 - JUN 23	0.9	0.94
8	JUN 24 - JUL 7	0.7	1.09
9	JUL 8 - JUL 21	0.8	1.04
10	JUL 22 - AUG 4	0.8	1.10
11	AUG 5 - AUG 18	0.7	0.94
12	AUG 19 - SEP 1	1.0	0.88
13	SEP 2 - SEP 15	1.1	1.05
14	SEP 16 - SEP 29	1.1	0.99
15	SEP 30 - OCT 13	0.6	1.06
16	OCT 14 - OCT 27	0.5	0.68
17	OCT 28 - NOV 10	0.6	1.00
18	NOV 11 - NOV 24	0.6	1.02
19	NOV 25 - DEC 8	0.6	0.98
20	DEC 9 - DEC 22	0.7	1.22
21	DEC 23 - JAN 5	0.8	1.10
22	JAN 6 - JAN 19	1.0	0.86
23	JAN 20 - FEB 2	1.0	1.13
24	FEB 3 - FEB 16	0.8	1.34
25	FEB 17 - MAR 2	0.7	0.99
26	MAR 3 - MAR 16	1.0	1.10

Summary for CARMAN

Average	0.8	1.03
Minimum	0.5	0.68
Maximum	1.1	1.34
Samples Above Limit	0	
Samples Below Limits	14	
% Outside Limits:	54%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	CARTIER REGIONAL	FLUORIDATOR	N/A
OPERATOR	Dave Pirt	CHEMICAL	H2SiF6 25 %
PHONE	353-4055	NATURAL FLUORIDE	0

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.9	1.00
2 APR 1 - APR 14	0.9	1.20
3 APR 15 - APR 28	0.9	NOT AVAILABLE
4 APR 29 - MAY 12	0.9	1.00
5 MAY 13 - MAY 28	1.0	1.00
6 MAY 29 - JUN 9	1.1	1.10
7 JUN 10 - JUN 23	1.1	1.10
8 JUN 24 - JUL 7	1.0	1.00
9 JUL 8 - JUL 21	1.0	1.00
10 JUL 22 - AUG 4	1.0	1.00
11 AUG 5 - AUG 18	1.0	1.10
12 AUG 19 - SEP 1	1.0	1.10
13 SEP 2 - SEP 15	1.1	0.90
14 SEP 16 - SEP 29	1.0	1.10
15 SEP 30 - OCT 13	1.1	1.10
16 OCT 14 - OCT 27	1.0	1.10
17 OCT 28 - NOV 10	0.9	1.00
18 NOV 11 - NOV 24	0.8	NOT AVAILABLE
19 NOV 25 - DEC 8	0.7	1.20
20 DEC 9 - DEC 22	0.6	0.80
21 DEC 23 - JAN 5	0.6	0.90
22 JAN 6 - JAN 19	0.7	1.00
23 JAN 20 - FEB 2	0.7	1.00
24 FEB 3 - FEB 16	0.7	1.00
25 FEB 17 - MAR 2	0.7	1.00
26 MAR 3 - MAR 16	0.8	1.10

Summary for CARTIER REGIONAL

Average	0.9	1.03
Minimum	0.6	0.80
Maximum	1.1	1.20
Samples Above Limit	0	
Samples Below Limits	7	
% Outside Limits:	27%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	CHURCHILL	FLUORIDATOR	Prom Gamma
OPERATOR	William Ayotte	CHEMICAL	H2SiF6 25 %
PHONE	675-8871	NATURAL FLUORIDE	< 0.10

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	0.80
2	APR 1 - APR 14	0.8	0.90
3	APR 15 - APR 28	0.8	0.90
4	APR 29 - MAY 12	0.9	1.00
5	MAY 13 - MAY 28	0.9	1.00
6	MAY 29 - JUN 9	0.8	1.00
7	JUN 10 - JUN 23	1.0	1.00
8	JUN 24 - JUL 7	1.1	1.10
9	JUL 8 - JUL 21	1.0	NOT AVAILABLE
10	JUL 22 - AUG 4	1.0	1.40
11	AUG 5 - AUG 18	0.8	1.10
12	AUG 19 - SEP 1	1.0	1.10
13	SEP 2 - SEP 15	0.8	1.00
14	SEP 16 - SEP 29	0.9	0.90
15	SEP 30 - OCT 13	0.8	1.10
16	OCT 14 - OCT 27	0.7	0.90
17	OCT 28 - NOV 10	0.7	0.90
18	NOV 11 - NOV 24	0.7	1.00
19	NOV 25 - DEC 8	0.7	0.90
20	DEC 9 - DEC 22	0.9	1.00
21	DEC 23 - JAN 5	0.8	NOT AVAILABLE
22	JAN 6 - JAN 19	1.0	1.10
23	JAN 20 - FEB 2	1.0	1.00
24	FEB 3 - FEB 16	1.0	1.10
25	FEB 17 - MAR 2	0.8	1.00
26	MAR 3 - MAR 16	1.0	1.10

Summary for CHURCHILL

Average	0.9	1.01
Minimum	0.7	0.80
Maximum	1.1	1.40
Samples Above Limit	0	
Samples Below Limits	4	
% Outside Limits:	15%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION CRANBERRY PORTAGE

FLUORIDATOR

LMI A151

OPERATOR Darcy Rajczakowski

CHEMICAL

NaF 4 %

PHONE 472-6321

NATURAL FLUORIDE < 0.10

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	1.2	NOT AVAILABLE
2	APR 1 - APR 14	1.1	NOT AVAILABLE
3	APR 15 - APR 28	1.0	NOT AVAILABLE
4	APR 29 - MAY 12	1.2	NOT AVAILABLE
5	MAY 13 - MAY 28	1.0	NOT AVAILABLE
6	MAY 29 - JUN 9	1.1	NOT AVAILABLE
7	JUN 10 - JUN 23	0.9	NOT AVAILABLE
8	JUN 24 - JUL 7	1.0	NOT AVAILABLE
9	JUL 8 - JUL 21	1.0	1.00
10	JUL 22 - AUG 4	1.0	NOT AVAILABLE
11	AUG 5 - AUG 18	1.1	NOT AVAILABLE
12	AUG 19 - SEP 1	1.1	NOT AVAILABLE
13	SEP 2 - SEP 15	1.0	NOT AVAILABLE
14	SEP 16 - SEP 29	1.0	NOT AVAILABLE
15	SEP 30 - OCT 13	1.0	NOT AVAILABLE
16	OCT 14 - OCT 27	1.0	NOT AVAILABLE
17	OCT 28 - NOV 10	1.0	NOT AVAILABLE
18	NOV 11 - NOV 24	1.0	NOT AVAILABLE
19	NOV 25 - DEC 8	0.9	NOT AVAILABLE
20	DEC 9 - DEC 22	1.2	NOT AVAILABLE
21	DEC 23 - JAN 5	1.0	NOT AVAILABLE
22	JAN 6 - JAN 19	1.1	NOT AVAILABLE
23	JAN 20 - FEB 2	1.0	NOT AVAILABLE
24	FEB 3 - FEB 16	1.1	NOT AVAILABLE
25	FEB 17 - MAR 2	1.0	NOT AVAILABLE
26	MAR 3 - MAR 16	1.2	NOT AVAILABLE

Summary for CRANBERRY PORTAGE

Average	1.0	1.00
Minimum	0.9	1.00
Maximum	1.2	1.00
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION CROSS LAKE RESERVE

FLUORIDATOR

LMI Saturator

OPERATOR Lawrence McLeod

CHEMICAL

NaF 4 %

PHONE 676-2044

NATURAL FLUORIDE < 0.10

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.1	1.00
2 APR 1 - APR 14	1.1	1.10
3 APR 15 - APR 28	0.9	1.00
4 APR 29 - MAY 12	1.4	1.00
5 MAY 13 - MAY 28	1.7	1.50
6 MAY 29 - JUN 9	1.1	0.90
7 JUN 10 - JUN 23	1.1	1.00
8 JUN 24 - JUL 7	1.1	0.80
9 JUL 8 - JUL 21	0.9	0.90
10 JUL 22 - AUG 4	1.2	1.10
11 AUG 5 - AUG 18	1.0	1.00
12 AUG 19 - SEP 1	1.0	0.80
13 SEP 2 - SEP 15	1.2	1.10
14 SEP 16 - SEP 29	1.1	1.10
15 SEP 30 - OCT 13	1.0	1.10
16 OCT 14 - OCT 27	0.8	1.00
17 OCT 28 - NOV 10	1.2	1.20
18 NOV 11 - NOV 24	1.1	1.30
19 NOV 25 - DEC 8	1.0	1.10
20 DEC 9 - DEC 22	1.0	1.10
21 DEC 23 - JAN 5	1.0	0.90
22 JAN 6 - JAN 19	1.0	1.20
23 JAN 20 - FEB 2	1.0	1.00
24 FEB 3 - FEB 16	0.9	1.00
25 FEB 17 - MAR 2	1.0	1.20
26 MAR 3 - MAR 16	0.9	0.90

Summary for CROSS LAKE RESERVE

Average	1.1	1.05
Minimum	0.8	0.80
Maximum	1.7	1.50
Samples Above Limit	2	
Samples Below Limits	0	
% Outside Limits:	8%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	DAUPHIN	FLUORIDATOR	W&T A690 Pa
OPERATOR	Bill Brenner	CHEMICAL	H2SiF6 25 %
PHONE	622-3200	NATURAL FLUORIDE	0.14

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.0	1.00
2 APR 1 - APR 14	1.0	0.97
3 APR 15 - APR 28	1.0	1.00
4 APR 29 - MAY 12	1.1	1.07
5 MAY 13 - MAY 28	1.1	1.09
6 MAY 29 - JUN 9	0.9	1.03
7 JUN 10 - JUN 23	1.0	0.97
8 JUN 24 - JUL 7	1.1	1.10
9 JUL 8 - JUL 21	1.0	1.01
10 JUL 22 - AUG 4	1.0	1.02
11 AUG 5 - AUG 18	1.0	1.07
12 AUG 19 - SEP 1	1.1	1.09
13 SEP 2 - SEP 15	1.0	1.05
14 SEP 16 - SEP 29	1.1	1.15
15 SEP 30 - OCT 13	1.0	1.15
16 OCT 14 - OCT 27	0.9	1.08
17 OCT 28 - NOV 10	1.0	1.12
18 NOV 11 - NOV 24	0.9	1.00
19 NOV 25 - DEC 8	0.9	1.10
20 DEC 9 - DEC 22	0.9	1.03
21 DEC 23 - JAN 5	1.0	1.08
22 JAN 6 - JAN 19	1.0	1.02
23 JAN 20 - FEB 2	1.0	1.06
24 FEB 3 - FEB 16	0.9	0.98
25 FEB 17 - MAR 2	0.9	1.19
26 MAR 3 - MAR 16	1.1	1.07

Summary for DAUPHIN

Average	1.0	1.06
Minimum	0.9	0.97
Maximum	1.1	1.19
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	DELORAINÉ	FLUORIDATOR	LMI Saturator
OPERATOR	Kent Corkish	CHEMICAL	NaF 4 %
PHONE	747-2655	NATURAL FLUORIDE	0.16

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.0	1.14
2 APR 1 - APR 14	1.0	1.18
3 APR 15 - APR 28	1.0	1.20
4 APR 29 - MAY 12	0.9	1.16
5 MAY 13 - MAY 28	0.9	1.13
6 MAY 29 - JUN 9	0.9	1.09
7 JUN 10 - JUN 23	0.9	1.09
8 JUN 24 - JUL 7	0.8	1.15
9 JUL 8 - JUL 21	0.9	1.05
10 JUL 22 - AUG 4	0.8	1.06
11 AUG 5 - AUG 18	0.9	1.10
12 AUG 19 - SEP 1	0.9	1.15
13 SEP 2 - SEP 15	0.9	1.09
14 SEP 16 - SEP 29	1.1	1.07
15 SEP 30 - OCT 13	0.8	1.07
16 OCT 14 - OCT 27	0.8	1.02
17 OCT 28 - NOV 10	0.8	1.09
18 NOV 11 - NOV 24	0.9	1.07
19 NOV 25 - DEC 8	0.9	1.12
20 DEC 9 - DEC 22	0.9	1.14
21 DEC 23 - JAN 5	0.9	1.10
22 JAN 6 - JAN 19	1.0	1.05
23 JAN 20 - FEB 2	0.9	1.06
24 FEB 3 - FEB 16	0.8	1.01
25 FEB 17 - MAR 2	0.9	1.13
26 MAR 3 - MAR 16	1.0	1.11

Summary for DELORAINÉ

Average	0.9	1.10
Minimum	0.8	1.01
Maximum	1.1	1.20
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION FLIN FLON	FLUOP'DATOR	Prominent
OPERATOR Kevin Komarnicki	CHEMICAL	H ₂ SiF ₆ 25 %
PHONE 681-7511	NATURAL FLUORIDE	< 0.10

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.1	0.93
2 APR 1 - APR 14	0.9	0.95
3 APR 15 - APR 28	0.9	0.96
4 APR 29 - MAY 12	1.1	1.10
5 MAY 13 - MAY 28	1.0	1.10
6 MAY 29 - JUN 9	0.9	1.11
7 JUN 10 - JUN 23	1.1	1.13
8 JUN 24 - JUL 7	1.2	1.29
9 JUL 8 - JUL 21	1.0	1.23
10 JUL 22 - AUG 4	1.0	1.23
11 AUG 5 - AUG 18	0.9	1.16
12 AUG 19 - SEP 1	1.0	1.19
13 SEP 2 - SEP 15	1.0	1.18
14 SEP 16 - SEP 29	0.9	1.15
15 SEP 30 - OCT 13	0.9	1.18
16 OCT 14 - OCT 27	0.9	1.01
17 OCT 28 - NOV 10	1.0	1.09
18 NOV 11 - NOV 24	0.9	1.16
19 NOV 25 - DEC 8	0.9	1.06
20 DEC 9 - DEC 22	0.9	1.17
21 DEC 23 - JAN 5	1.0	1.24
22 JAN 6 - JAN 19	1.0	0.92
23 JAN 20 - FEB 2	0.9	0.99
24 FEB 3 - FEB 16	1.0	1.05
25 FEB 17 - MAR 2	1.0	1.13
26 MAR 3 - MAR 16	1.1	1.07

Summary for FLIN FLON

Average	1.0	1.11
Minimum	0.9	0.92
Maximum	1.2	1.29
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION GILBERT PLAINS

FLUORIDATOR

LMI A741

OPERATOR Lloyd Beckley

CHEMICAL

NaF 4 %

PHONE 548-2149

NATURAL FLUORIDE 0.19

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.6	0.70
2	APR 1 - APR 14	0.4	0.75
3	APR 15 - APR 28	0.8	1.00
4	APR 29 - MAY 12	0.9	1.05
5	MAY 13 - MAY 28	1.1	1.20
6	MAY 29 - JUN 9	0.9	1.00
7	JUN 10 - JUN 23	0.7	0.80
8	JUN 24 - JUL 7	0.7	0.80
9	JUL 8 - JUL 21	0.6	0.70
10	JUL 22 - AUG 4	0.8	0.85
11	AUG 5 - AUG 18	0.4	0.60
12	AUG 19 - SEP 1	0.7	0.86
13	SEP 2 - SEP 15	0.8	1.00
14	SEP 16 - SEP 29	1.0	0.92
15	SEP 30 - OCT 13	0.7	0.80
16	OCT 14 - OCT 27	0.6	0.85
17	OCT 28 - NOV 10	1.0	1.07
18	NOV 11 - NOV 24	0.9	1.00
19	NOV 25 - DEC 8	0.9	1.05
20	DEC 9 - DEC 22	0.9	1.05
21	DEC 23 - JAN 5	0.8	0.85
22	JAN 6 - JAN 19	0.6	0.80
23	JAN 20 - FEB 2	0.5	0.80
24	FEB 3 - FEB 16	1.0	1.22
25	FEB 17 - MAR 2	0.9	1.22
26	MAR 3 - MAR 16	0.8	0.95

Summary for GILBERT PLAINS

Average	0.8	0.92
Minimum	0.4	0.60
Maximum	1.1	1.22
Samples Above Limit	0	
Samples Below Limits	11	
% Outside Limits:	42%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	GILLAM	FLUORIDATOR	W&T
OPERATOR	John McDonald	CHEMICAL	H2SiF6 25 %
PHONE	652-2121	NATURAL FLUORIDE	< 0.10

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.1	1.13
2 APR 1 - APR 14	1.0	1.08
3 APR 15 - APR 28	1.1	1.14
4 APR 29 - MAY 12	1.0	1.80
5 MAY 13 - MAY 28	0.9	1.10
6 MAY 29 - JUN 9	1.1	1.38
7 JUN 10 - JUN 23	0.9	1.16
8 JUN 24 - JUL 7	0.9	0.97
9 JUL 8 - JUL 21	0.9	1.00
10 JUL 22 - AUG 4	1.1	1.14
11 AUG 5 - AUG 18	1.1	1.02
12 AUG 19 - SEP 1	1.2	1.24
13 SEP 2 - SEP 15	1.1	1.45
14 SEP 16 - SEP 29	1.0	0.79
15 SEP 30 - OCT 13	0.9	1.21
16 OCT 14 - OCT 27	1.0	1.23
17 OCT 28 - NOV 10	1.1	1.50
18 NOV 11 - NOV 24	0.9	0.92
19 NOV 25 - DEC 8	0.9	1.28
20 DEC 9 - DEC 22	0.9	1.29
21 DEC 23 - JAN 5	1.0	NOT AVAILABLE
22 JAN 6 - JAN 19	1.0	1.13
23 JAN 20 - FEB 2	0.9	1.39
24 FEB 3 - FEB 16	1.0	1.19
25 FEB 17 - MAR 2	1.0	NOT AVAILABLE
26 MAR 3 - MAR 16	1.1	NOT AVAILABLE

Summary for GILLAM

Average	1.0	1.20
Minimum	0.9	0.79
Maximum	1.2	1.80
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION GIMLI INDUSTRIAL PARK
 OPERATOR Richard Bezdietny
 PHONE 642-8593

FLUORIDATOR W&T A747
 CHEMICAL NaF 4 %
 NATURAL FLUORIDE 0.43

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	1.01
2	APR 1 - APR 14	1.0	0.98
3	APR 15 - APR 28	0.9	1.00
4	APR 29 - MAY 12	0.9	1.03
5	MAY 13 - MAY 28	0.9	1.00
6	MAY 29 - JUN 9	1.0	1.00
7	JUN 10 - JUN 23	1.1	1.07
8	JUN 24 - JUL 7	0.7	0.86
9	JUL 8 - JUL 21	1.0	1.00
10	JUL 22 - AUG 4	1.0	1.03
11	AUG 5 - AUG 18	1.0	1.10
12	AUG 19 - SEP 1	0.9	0.98
13	SEP 2 - SEP 15	0.9	0.95
14	SEP 16 - SEP 29	1.1	1.17
15	SEP 30 - OCT 13	1.0	1.06
16	OCT 14 - OCT 27	0.9	1.00
17	OCT 28 - NOV 10	0.8	0.90
18	NOV 11 - NOV 24	0.7	0.82
19	NOV 25 - DEC 8	0.8	1.00
20	DEC 9 - DEC 22	0.9	1.00
21	DEC 23 - JAN 5	0.9	1.03
22	JAN 6 - JAN 19	1.0	1.02
23	JAN 20 - FEB 2	0.9	1.00
24	FEB 3 - FEB 16	0.9	1.00
25	FEB 17 - MAR 2	0.8	1.04
26	MAR 3 - MAR 16	1.0	1.00

Summary for GIMLI INDUSTRIAL PARK

Average	0.9	1.00
Minimum	0.7	0.82
Maximum	1.1	1.17
Samples Above Limit	0	
Samples Below Limits	2	
% Outside Limits:	8%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	GLADSTONE	FLUORIDATOR	W&T A745
OPERATOR	Glen Emerson	CHEMICAL	Na2SiF6 (Dry)
PHONE	385-2332	NATURAL FLUORIDE	0.22

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	1.04
2	APR 1 - APR 14	0.9	0.95
3	APR 15 - APR 28	1.0	1.11
4	APR 29 - MAY 12	0.8	0.96
5	MAY 13 - MAY 28	0.9	0.87
6	MAY 29 - JUN 9	1.0	1.03
7	JUN 10 - JUN 23	1.0	1.02
8	JUN 24 - JUL 7	1.0	0.88
9	JUL 8 - JUL 21	0.9	0.95
10	JUL 22 - AUG 4	0.9	1.00
11	AUG 5 - AUG 18	0.9	0.95
12	AUG 19 - SEP 1	0.9	0.95
13	SEP 2 - SEP 15	0.8	0.99
14	SEP 16 - SEP 29	1.0	1.08
15	SEP 30 - OCT 13	0.2	0.65
16	OCT 14 - OCT 27	NOT AVAILABLE	NOT AVAILABLE
17	OCT 28 - NOV 10	NOT AVAILABLE	NOT AVAILABLE
18	NOV 11 - NOV 24	NOT AVAILABLE	NOT AVAILABLE
19	NOV 25 - DEC 8	NOT AVAILABLE	NOT AVAILABLE
20	DEC 9 - DEC 22	NOT AVAILABLE	NOT AVAILABLE
21	DEC 23 - JAN 5	NOT AVAILABLE	NOT AVAILABLE
22	JAN 6 - JAN 19	NOT AVAILABLE	NOT AVAILABLE
23	JAN 20 - FEB 2	NOT AVAILABLE	NOT AVAILABLE
24	FEB 3 - FEB 16	NOT AVAILABLE	NOT AVAILABLE
25	FEB 17 - MAR 2	NOT AVAILABLE	NOT AVAILABLE
26	MAR 3 - MAR 16	NOT AVAILABLE	NOT AVAILABLE

Summary for GLADSTONE

Average	0.9	0.96
Minimum	0.2	0.65
Maximum	1.0	1.11
Samples Above Limit	0	
Samples Below Limits	1	
% Outside Limits:	7%	
Number of Samples	15	

Fluoride Control Data 2006 / 2007

LOCATION	GRISWOLD SIOUX VALLEY BAND	FLUORIDATOR	N/A
OPERATOR	Avin Dowan	CHEMICAL	NaF 4 %
PHONE	855-2690	NATURAL FLUORIDE	0.1

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	NOT AVAILABLE	NOT AVAILABLE
2	APR 1 - APR 14	0.7	NOT AVAILABLE
3	APR 15 - APR 28	0.6	NOT AVAILABLE
4	APR 29 - MAY 12	0.6	NOT AVAILABLE
5	MAY 13 - MAY 28	0.7	NOT AVAILABLE
6	MAY 29 - JUN 9	0.7	NOT AVAILABLE
7	JUN 10 - JUN 23	0.9	NOT AVAILABLE
8	JUN 24 - JUL 7	0.5	NOT AVAILABLE
9	JUL 8 - JUL 21	0.7	NOT AVAILABLE
10	JUL 22 - AUG 4	0.7	NOT AVAILABLE
11	AUG 5 - AUG 18	0.7	NOT AVAILABLE
12	AUG 19 - SEP 1	0.5	NOT AVAILABLE
13	SEP 2 - SEP 15	NOT AVAILABLE	NOT AVAILABLE
14	SEP 16 - SEP 29	NOT AVAILABLE	NOT AVAILABLE
15	SEP 30 - OCT 13	0.9	NOT AVAILABLE
16	OCT 14 - OCT 27	1.0	NOT AVAILABLE
17	OCT 28 - NOV 10	0.7	NOT AVAILABLE
18	NOV 11 - NOV 24	0.7	NOT AVAILABLE
19	NOV 25 - DEC 8	NOT AVAILABLE	NOT AVAILABLE
20	DEC 9 - DEC 22	NOT AVAILABLE	NOT AVAILABLE
21	DEC 23 - JAN 5	NOT AVAILABLE	NOT AVAILABLE
22	JAN 6 - JAN 19	NOT AVAILABLE	NOT AVAILABLE
23	JAN 20 - FEB 2	NOT AVAILABLE	NOT AVAILABLE
24	FEB 3 - FEB 16	NOT AVAILABLE	NOT AVAILABLE
25	FEB 17 - MAR 2	NOT AVAILABLE	NOT AVAILABLE
26	MAR 3 - MAR 16	NOT AVAILABLE	NOT AVAILABLE

Summary for GRISWOLD SIOUX VALLEY BAND

Average	0.7
Minimum	0.5
Maximum	1.0
Samples Above Limit	0
Samples Below Limits	12
% Outside Limits	80%
Number of Samples	15

Fluoride Control Data 2006 / 2007

LOCATION	HAMIOTA	FLUORIDATOR	LMI A751
OPERATOR	Ken Curle	CHEMICAL	NaF 4 %
PHONE	764-2779	NATURAL FLUORIDE	0.29

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.2	1.24
2 APR 1 - APR 14	0.9	0.93
3 APR 15 - APR 28	0.8	0.97
4 APR 29 - MAY 12	1.3	1.06
5 MAY 13 - MAY 28	1.2	1.45
6 MAY 29 - JUN 9	1.1	1.14
7 JUN 10 - JUN 23	1.2	1.10
8 JUN 24 - JUL 7	1.3	1.10
9 JUL 8 - JUL 21	1.2	1.13
10 JUL 22 - AUG 4	1.1	1.07
11 AUG 5 - AUG 18	1.1	1.05
12 AUG 19 - SEP 1	1.2	0.70
13 SEP 2 - SEP 15	1.1	1.10
14 SEP 16 - SEP 29	1.1	1.12
15 SEP 30 - OCT 13	1.0	1.01
16 OCT 14 - OCT 27	0.9	0.96
17 OCT 28 - NOV 10	1.0	1.05
18 NOV 11 - NOV 24	0.9	0.88
19 NOV 25 - DEC 8	1.0	1.08
20 DEC 9 - DEC 22	1.1	1.14
21 DEC 23 - JAN 5	1.2	1.19
22 JAN 6 - JAN 19	1.0	1.25
23 JAN 20 - FEB 2	1.2	1.10
24 FEB 3 - FEB 16	1.1	1.01
25 FEB 17 - MAR 2	1.0	1.25
26 MAR 3 - MAR 16	0.6	0.72

Summary for HAMIOTA

Average	1.1	1.07
Minimum	0.6	0.70
Maximum	1.3	1.45
Samples Above Limit	2	
Samples Below Limits	1	
% Outside Limits:	12%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	HARTNEY	FLUORIDATOR	LMI A741
OPERATOR	Greg Morrison	CHEMICAL	NaF 4 %
PHONE	858-2429	NATURAL FLUORIDE	0.2

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	1.0	1.00
2	APR 1 - APR 14	0.9	0.95
3	APR 15 - APR 28	0.9	0.95
4	APR 29 - MAY 12	0.9	0.95
5	MAY 13 - MAY 28	1.0	0.95
6	MAY 29 - JUN 9	1.0	1.05
7	JUN 10 - JUN 23	1.1	1.00
8	JUN 24 - JUL 7	1.0	1.00
9	JUL 8 - JUL 21	0.9	0.95
10	JUL 22 - AUG 4	0.9	0.95
11	AUG 5 - AUG 18	0.8	0.95
12	AUG 19 - SEP 1	0.9	0.90
13	SEP 2 - SEP 15	0.8	NOT AVAILABLE
14	SEP 16 - SEP 29	1.0	NOT AVAILABLE
15	SEP 30 - OCT 13	0.7	0.90
16	OCT 14 - OCT 27	0.5	0.85
17	OCT 28 - NOV 10	1.1	1.00
18	NOV 11 - NOV 24	0.8	1.00
19	NOV 25 - DEC 8	1.1	1.10
20	DEC 9 - DEC 22	1.1	1.10
21	DEC 23 - JAN 5	1.1	0.70
22	JAN 6 - JAN 19	2.0	0.86
23	JAN 20 - FEB 2	5.9	1.19
24	FEB 3 - FEB 16	4.8	1.18
25	FEB 17 - MAR 2	1.9	1.00
26	MAR 3 - MAR 16	2.5	0.90

Summary for HARTNEY

Average	1.4	0.97
Minimum	0.5	0.70
Maximum	5.9	1.19
Samples Above Limit	5	
Samples Below Limits	2	
% Outside Limits:	27%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION KILLARNEY
 OPERATOR Shawn Lamb
 PHONE 523-8944

FLUORIDATOR LMI B721
 CHEMICAL NaF 4 %
 NATURAL FLUORIDE 0.19

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.1	1.69
2 APR 1 - APR 14	1.1	1.20
3 APR 15 - APR 28	0.9	1.20
4 APR 29 - MAY 12	1.0	1.30
5 MAY 13 - MAY 28	1.2	1.43
6 MAY 29 - JUN 9	0.9	1.33
7 JUN 10 - JUN 23	1.1	1.44
8 JUN 24 - JUL 7	1.0	1.61
9 JUL 8 - JUL 21	0.9	1.43
10 JUL 22 - AUG 4	0.6	1.23
11 AUG 5 - AUG 18	0.5	1.22
12 AUG 19 - SEP 1	0.6	1.21
13 SEP 2 - SEP 15	0.5	1.07
14 SEP 16 - SEP 29	1.0	1.35
15 SEP 30 - OCT 13	0.3	0.89
16 OCT 14 - OCT 27	1.2	1.54
17 OCT 28 - NOV 10	1.0	1.66
18 NOV 11 - NOV 24	1.3	1.66
19 NOV 25 - DEC 8	1.2	1.79
20 DEC 9 - DEC 22	0.3	0.96
21 DEC 23 - JAN 5	1.1	1.91
22 JAN 6 - JAN 19	1.3	1.66
23 JAN 20 - FEB 2	1.0	1.62
24 FEB 3 - FEB 16	1.5	1.84
25 FEB 17 - MAR 2	0.8	1.67
26 MAR 3 - MAR 16	1.4	2.02

Summary for KILLARNEY

Average	1.0	1.46
Minimum	0.3	0.89
Maximum	1.5	2.02
Samples Above Limit	4	
Samples Below Limits	6	
% Outside Limits:	38%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION LETELLIER-RRRWTP

FLUORIDATOR

LMI

OPERATOR Kurt Henry

CHEMICAL

H₂SiF₆ 25 %

PHONE 737-2265

NATURAL FLUORIDE 0.17

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	1.1	1.22
2	APR 1 - APR 14	1.1	1.11
3	APR 15 - APR 28	1.0	1.10
4	APR 29 - MAY 12	1.0	1.16
5	MAY 13 - MAY 28	1.0	1.04
6	MAY 29 - JUN 9	0.9	1.09
7	JUN 10 - JUN 23	1.1	1.10
8	JUN 24 - JUL 7	1.1	1.11
9	JUL 8 - JUL 21	1.0	NOT AVAILABLE
10	JUL 22 - AUG 4	1.0	1.05
11	AUG 5 - AUG 18	1.0	1.10
12	AUG 19 - SEP 1	1.1	1.10
13	SEP 2 - SEP 15	1.0	1.15
14	SEP 16 - SEP 29	1.1	1.10
15	SEP 30 - OCT 13	1.0	1.17
16	OCT 14 - OCT 27	1.0	1.19
17	OCT 28 - NOV 10	1.0	1.15
18	NOV 11 - NOV 24	1.0	1.12
19	NOV 25 - DEC 8	1.0	1.15
20	DEC 9 - DEC 22	1.0	1.22
21	DEC 23 - JAN 5	1.1	1.22
22	JAN 6 - JAN 19	1.0	1.11
23	JAN 20 - FEB 2	1.0	1.08
24	FEB 3 - FEB 16	1.1	1.10
25	FEB 17 - MAR 2	0.9	1.13
26	MAR 3 - MAR 16	1.1	1.10

Summary for LETELLIER-RRRWTP

Average	1.0	1.13
Minimum	0.9	1.04
Maximum	1.1	1.22
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	LONG PLAIN	FLUORIDATOR	LMI Saturator
OPERATOR	Morris Peters	CHEMICAL	NaF 4 %
PHONE	252-2094	NATURAL FLUORIDE	0.23

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.7	0.82
2	APR 1 - APR 14	0.8	1.50
3	APR 15 - APR 28	0.6	0.92
4	APR 29 - MAY 12	0.7	0.84
5	MAY 13 - MAY 28	0.9	0.85
6	MAY 29 - JUN 9	0.8	0.82
7	JUN 10 - JUN 23	0.9	0.84
8	JUN 24 - JUL 7	1.1	0.79
9	JUL 8 - JUL 21	1.0	NOT AVAILABLE
10	JUL 22 - AUG 4	0.8	NOT AVAILABLE
11	AUG 5 - AUG 18	0.7	NOT AVAILABLE
12	AUG 19 - SEP 1	0.7	NOT AVAILABLE
13	SEP 2 - SEP 15	0.9	NOT AVAILABLE
14	SEP 16 - SEP 29	1.0	NOT AVAILABLE
15	SEP 30 - OCT 13	0.6	0.87
16	OCT 14 - OCT 27	0.6	1.08
17	OCT 28 - NOV 10	0.6	0.89
18	NOV 11 - NOV 24	0.6	0.85
19	NOV 25 - DEC 8	0.7	0.84
20	DEC 9 - DEC 22	0.7	NOT AVAILABLE
21	DEC 23 - JAN 5	0.9	1.32
22	JAN 6 - JAN 19	0.9	NOT AVAILABLE
23	JAN 20 - FEB 2	0.7	NOT AVAILABLE
24	FEB 3 - FEB 16	1.1	1.26
25	FEB 17 - MAR 2	1.4	NOT AVAILABLE
26	MAR 3 - MAR 16	1.4	NOT AVAILABLE

Summary for LONG PLAIN

Average	0.8	0.97
Minimum	0.6	0.79
Maximum	1.4	1.50
Samples Above Limit	2	
Samples Below Limits	12	
% Outside Limits:	54%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	MANITOU	FLUORIDATOR	LMI Saturator
OPERATOR	Bob Barett	CHEMICAL	NaF 4 %
PHONE	242-3169	NATURAL FLUORIDE	0.19

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.0	1.13
2 APR 1 - APR 14	1.0	1.14
3 APR 15 - APR 28	1.0	1.13
4 APR 29 - MAY 12	1.0	1.04
5 MAY 13 - MAY 28	1.1	1.18
6 MAY 29 - JUN 9	1.0	1.18
7 JUN 10 - JUN 23	1.1	1.13
8 JUN 24 - JUL 7	1.1	1.13
9 JUL 8 - JUL 21	1.0	1.10
10 JUL 22 - AUG 4	0.9	NOT AVAILABLE
11 AUG 5 - AUG 18	1.1	1.23
12 AUG 19 - SEP 1	1.0	1.17
13 SEP 2 - SEP 15	1.0	1.14
14 SEP 16 - SEP 29	1.1	1.13
15 SEP 30 - OCT 13	0.9	1.08
16 OCT 14 - OCT 27	0.9	1.13
17 OCT 28 - NOV 10	1.0	1.08
18 NOV 11 - NOV 24	1.0	1.15
19 NOV 25 - DEC 8	0.9	1.14
20 DEC 9 - DEC 22	1.0	1.00
21 DEC 23 - JAN 5	1.1	1.03
22 JAN 6 - JAN 19	0.9	1.26
23 JAN 20 - FEB 2	1.0	1.11
24 FEB 3 - FEB 16	0.9	1.10
25 FEB 17 - MAR 2	0.9	1.10
26 MAR 3 - MAR 16	1.1	1.12

Summary for MANITOU

Average	1.0	1.13
Minimum	0.9	1.00
Maximum	1.1	1.26
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	MELITA	FLUORIDATOR	W&T Saturato
OPERATOR	Bob Reddaway	CHEMICAL	NaF 4 %
PHONE	522-3413	NATURAL FLUORIDE	0.18

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.9	1.24
2 APR 1 - APR 14	0.9	1.33
3 APR 15 - APR 28	0.9	1.41
4 APR 29 - MAY 12	0.4	0.91
5 MAY 13 - MAY 28	0.7	1.17
6 MAY 29 - JUN 9	0.9	1.11
7 JUN 10 - JUN 23	1.0	1.29
8 JUN 24 - JUL 7	0.9	1.27
9 JUL 8 - JUL 21	0.9	1.31
10 JUL 22 - AUG 4	1.1	1.35
11 AUG 5 - AUG 18	1.0	1.49
12 AUG 19 - SEP 1	1.0	1.46
13 SEP 2 - SEP 15	0.9	1.31
14 SEP 16 - SEP 29	1.0	1.43
15 SEP 30 - OCT 13	0.8	1.44
16 OCT 14 - OCT 27	0.8	1.28
17 OCT 28 - NOV 10	0.6	1.16
18 NOV 11 - NOV 24	0.6	1.21
19 NOV 25 - DEC 8	0.9	1.28
20 DEC 9 - DEC 22	1.0	1.61
21 DEC 23 - JAN 5	1.0	1.48
22 JAN 6 - JAN 19	1.0	1.47
23 JAN 20 - FEB 2	1.0	1.66
24 FEB 3 - FEB 16	0.9	1.54
25 FEB 17 - MAR 2	0.8	1.46
26 MAR 3 - MAR 16	1.1	1.41

Summary for MELITA

Average	0.9	1.35
Minimum	0.4	0.91
Maximum	1.1	1.66
Samples Above Limit	0	
Samples Below Limits	4	
% Outside Limits:	15%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION MINNEDOSA
OPERATOR Frank Taylor
PHONE 867-2727

FLUORIDATOR Prominent
CHEMICAL H₂SiF₆ 25 %
NATURAL FLUORIDE 0.28

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.8	1.15
2 APR 1 - APR 14	0.9	1.15
3 APR 15 - APR 28	0.9	1.15
4 APR 29 - MAY 12	0.9	1.15
5 MAY 13 - MAY 28	0.9	1.20
6 MAY 29 - JUN 9	1.8	1.15
7 JUN 10 - JUN 23	NOT AVAILABLE	NOT AVAILABLE
8 JUN 24 - JUL 7	2.5	1.15
9 JUL 8 - JUL 21	0.8	1.10
10 JUL 22 - AUG 4	0.8	1.25
11 AUG 5 - AUG 18	0.8	1.05
12 AUG 19 - SEP 1	0.8	1.15
13 SEP 2 - SEP 15	0.8	1.05
14 SEP 16 - SEP 29	1.0	1.17
15 SEP 30 - OCT 13	0.8	1.18
16 OCT 14 - OCT 27	0.8	1.05
17 OCT 28 - NOV 10	0.7	1.18
18 NOV 11 - NOV 24	0.8	1.08
19 NOV 25 - DEC 8	0.8	1.05
20 DEC 9 - DEC 22	0.9	1.20
21 DEC 23 - JAN 5	0.9	1.15
22 JAN 6 - JAN 19	1.0	1.17
23 JAN 20 - FEB 2	0.9	1.18
24 FEB 3 - FEB 16	2.0	1.05
25 FEB 17 - MAR 2	1.0	1.15
26 MAR 3 - MAR 16	0.9	1.05

Summary for MINNEDOSA

Average	1.0	1.13
Minimum	0.7	1.05
Maximum	2.5	1.25
Samples Above Limit	3	
Samples Below Limits	1	
% Outside Limits:	16%	
Number of Samples	25	

Fluoride Control Data 2006 / 2007

LOCATION	MORDEN	FLUORIDATOR	Prominent
OPERATOR	Al Spearman	CHEMICAL	H ₂ SiF ₆ 25 %
PHONE	822-5707	NATURAL FLUORIDE	0.32

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.8	1.27
2 APR 1 - APR 14	0.8	1.05
3 APR 15 - APR 28	0.8	1.15
4 APR 29 - MAY 12	0.8	1.07
5 MAY 13 - MAY 28	0.8	1.09
6 MAY 29 - JUN 9	0.8	1.17
7 JUN 10 - JUN 23	0.8	1.07
8 JUN 24 - JUL 7	0.7	1.06
9 JUL 8 - JUL 21	0.9	1.00
10 JUL 22 - AUG 4	0.9	1.04
11 AUG 5 - AUG 18	0.8	1.15
12 AUG 19 - SEP 1	0.8	1.25
13 SEP 2 - SEP 15	1.0	1.10
14 SEP 16 - SEP 29	1.1	1.21
15 SEP 30 - OCT 13	0.8	1.21
16 OCT 14 - OCT 27	0.9	1.24
17 OCT 28 - NOV 10	1.0	1.27
18 NOV 11 - NOV 24	0.9	1.07
19 NOV 25 - DEC 8	0.8	1.01
20 DEC 9 - DEC 22	0.8	1.10
21 DEC 23 - JAN 5	0.8	1.18
22 JAN 6 - JAN 19	1.0	1.30
23 JAN 20 - FEB 2	0.8	1.31
24 FEB 3 - FEB 16	0.8	1.10
25 FEB 17 - MAR 2	0.7	1.15
26 MAR 3 - MAR 16	0.9	1.21

Summary for MORDEN

Average	0.8	1.15
Minimum	0.7	1.00
Maximum	1.1	1.31
Samples Above Limit	0	
Samples Below Limits	2	
% Outside Limits:	8%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	MORRIS	FLUORIDATOR	Prominent
OPERATOR	Richard Dupuis	CHEMICAL	H2SiF6 25 %
PHONE	746-2531	NATURAL FLUORIDE	0.22

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.0	1.13
2 APR 1 - APR 14	1.1	1.07
3 APR 15 - APR 28	1.0	1.08
4 APR 29 - MAY 12	1.0	1.09
5 MAY 13 - MAY 28	1.0	0.91
6 MAY 29 - JUN 9	0.9	1.24
7 JUN 10 - JUN 23	0.9	1.22
8 JUN 24 - JUL 7	0.9	1.25
9 JUL 8 - JUL 21	1.0	1.10
10 JUL 22 - AUG 4	0.9	1.18
11 AUG 5 - AUG 18	0.9	1.14
12 AUG 19 - SEP 1	1.0	1.18
13 SEP 2 - SEP 15	0.9	1.12
14 SEP 16 - SEP 29	1.1	1.20
15 SEP 30 - OCT 13	0.9	1.20
16 OCT 14 - OCT 27	0.8	1.10
17 OCT 28 - NOV 10	1.0	1.06
18 NOV 11 - NOV 24	0.9	1.08
19 NOV 25 - DEC 8	0.8	1.09
20 DEC 9 - DEC 22	1.0	0.95
21 DEC 23 - JAN 5	1.1	1.14
22 JAN 6 - JAN 19	1.0	1.01
23 JAN 20 - FEB 2	1.0	1.02
24 FEB 3 - FEB 16	1.0	1.02
25 FEB 17 - MAR 2	1.0	1.23
26 MAR 3 - MAR 16	1.3	1.11

Summary for MORRIS

Average	1.0	1.11
Minimum	0.8	0.91
Maximum	1.3	1.25
Samples Above Limit	1	
Samples Below Limits	0	
% Outside Limits:	4%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	NEEPAWA	FLUORIDATOR	W&T A690
OPERATOR	Dan Wagner	CHEMICAL	Na2SiF6 (Dry)
PHONE	476-7626	NATURAL FLUORIDE	0.24

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.6	0.85
2 APR 1 - APR 14	0.7	0.79
3 APR 15 - APR 28	0.7	0.85
4 APR 29 - MAY 12	0.8	0.69
5 MAY 13 - MAY 28	0.6	0.84
6 MAY 29 - JUN 9	0.7	1.21
7 JUN 10 - JUN 23	0.5	0.88
8 JUN 24 - JUL 7	0.7	0.70
9 JUL 8 - JUL 21	0.9	1.20
10 JUL 22 - AUG 4	0.6	0.85
11 AUG 5 - AUG 18	0.5	0.85
12 AUG 19 - SEP 1	0.8	0.70
13 SEP 2 - SEP 15	0.7	1.00
14 SEP 16 - SEP 29	1.0	0.83
15 SEP 30 - OCT 13	0.7	0.70
16 OCT 14 - OCT 27	0.7	0.70
17 OCT 28 - NOV 10	0.8	1.02
18 NOV 11 - NOV 24	0.5	0.95
19 NOV 25 - DEC 8	0.8	1.14
20 DEC 9 - DEC 22	0.8	1.09
21 DEC 23 - JAN 5	0.8	0.80
22 JAN 6 - JAN 19	0.5	0.62
23 JAN 20 - FEB 2	0.9	0.76
24 FEB 3 - FEB 16	0.7	1.02
25 FEB 17 - MAR 2	0.8	0.72
26 MAR 3 - MAR 16	0.8	1.00

Summary for NEEPAWA

Average	0.7	0.88
Minimum	0.5	0.62
Maximum	1.0	1.21
Samples Above Limit	0	
Samples Below Limits	15	
% Outside Limits:	58%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION PILOT MOUND

FLUORIDATOR

LMI Saturator

OPERATOR Ron Forbes

CHEMICAL

NaF 4 %

PHONE 825-2115

NATURAL FLUORIDE 0.21

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.6	1.09
2 APR 1 - APR 14	0.8	1.11
3 APR 15 - APR 28	0.7	1.03
4 APR 29 - MAY 12	0.8	1.01
5 MAY 13 - MAY 28	0.8	1.05
6 MAY 29 - JUN 9	0.7	0.85
7 JUN 10 - JUN 23	1.0	1.11
8 JUN 24 - JUL 7	0.8	1.00
9 JUL 8 - JUL 21	0.9	1.07
10 JUL 22 - AUG 4	0.8	0.99
11 AUG 5 - AUG 18	1.0	1.06
12 AUG 19 - SEP 1	0.8	1.10
13 SEP 2 - SEP 15	0.7	1.12
14 SEP 16 - SEP 29	1.0	0.94
15 SEP 30 - OCT 13	0.7	1.05
16 OCT 14 - OCT 27	0.7	1.13
17 OCT 28 - NOV 10	0.7	1.12
18 NOV 11 - NOV 24	0.6	1.00
19 NOV 25 - DEC 8	0.6	1.01
20 DEC 9 - DEC 22	0.7	1.09
21 DEC 23 - JAN 5	0.6	1.07
22 JAN 6 - JAN 19	0.6	1.02
23 JAN 20 - FEB 2	0.6	1.08
24 FEB 3 - FEB 16	0.6	1.10
25 FEB 17 - MAR 2	0.7	1.18
26 MAR 3 - MAR 16	0.7	1.10

Summary for PILOT MOUND

Average	0.7	1.06
Minimum	0.6	0.85
Maximum	1.0	1.18
Samples Above Limit	0	
Samples Below Limits	16	
% Outside Limits:	62%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION PINAWA	FLUORIDATOR	Pulse Mate
OPERATOR Jim Hoard	CHEMICAL	H2SiF6 25 %
PHONE 753-5100	NATURAL FLUORIDE	0.08

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.9	1.02
2 APR 1 - APR 14	0.7	0.96
3 APR 15 - APR 28	0.8	1.04
4 APR 29 - MAY 12	0.9	1.02
5 MAY 13 - MAY 28	1.0	1.09
6 MAY 29 - JUN 9	0.9	0.92
7 JUN 10 - JUN 23	0.9	0.94
8 JUN 24 - JUL 7	NOT AVAILABLE	NOT AVAILABLE
9 JUL 8 - JUL 21	NOT AVAILABLE	NOT AVAILABLE
10 JUL 22 - AUG 4	NOT AVAILABLE	NOT AVAILABLE
11 AUG 5 - AUG 18	NOT AVAILABLE	NOT AVAILABLE
12 AUG 19 - SEP 1	NOT AVAILABLE	NOT AVAILABLE
13 SEP 2 - SEP 15	NOT AVAILABLE	NOT AVAILABLE
14 SEP 16 - SEP 29	NOT AVAILABLE	NOT AVAILABLE
15 SEP 30 - OCT 13	NOT AVAILABLE	NOT AVAILABLE
16 OCT 14 - OCT 27	NOT AVAILABLE	NOT AVAILABLE
17 OCT 28 - NOV 10	NOT AVAILABLE	NOT AVAILABLE
18 NOV 11 - NOV 24	NOT AVAILABLE	NOT AVAILABLE
19 NOV 25 - DEC 8	NOT AVAILABLE	NOT AVAILABLE
20 DEC 9 - DEC 22	NOT AVAILABLE	NOT AVAILABLE
21 DEC 23 - JAN 5	NOT AVAILABLE	NOT AVAILABLE
22 JAN 6 - JAN 19	NOT AVAILABLE	NOT AVAILABLE
23 JAN 20 - FEB 2	NOT AVAILABLE	NOT AVAILABLE
24 FEB 3 - FEB 16	NOT AVAILABLE	NOT AVAILABLE
25 FEB 17 - MAR 2	NOT AVAILABLE	NOT AVAILABLE
26 MAR 3 - MAR 16	NOT AVAILABLE	NOT AVAILABLE

Summary for PINAWA

Average	0.9	1.00
Minimum	0.7	0.92
Maximum	1.0	1.09
Samples Above Limit	0	
Samples Below Limits	1	
% Outside Limits:	14%	
Number of Samples	7	

Fluoride Control Data 2006 / 2007

LOCATION	PORTAGE LA PRAIRIE	FLUORIDATOR	W&T A690
OPERATOR	Doug Campbell	CHEMICAL	H2SiF6 25 %
PHONE	239-8373	NATURAL FLUORIDE	0.2

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.8	0.98
2	APR 1 - APR 14	0.9	1.15
3	APR 15 - APR 28	0.8	0.70
4	APR 29 - MAY 12	0.9	1.10
5	MAY 13 - MAY 28	1.0	1.18
6	MAY 29 - JUN 9	1.1	1.32
7	JUN 10 - JUN 23	1.2	NOT AVAILABLE
8	JUN 24 - JUL 7	1.1	1.26
9	JUL 8 - JUL 21	1.0	0.22
10	JUL 22 - AUG 4	1.0	1.27
11	AUG 5 - AUG 18	0.9	1.16
12	AUG 19 - SEP 1	1.0	1.19
13	SEP 2 - SEP 15	1.0	1.32
14	SEP 16 - SEP 29	0.9	1.21
15	SEP 30 - OCT 13	0.8	1.28
16	OCT 14 - OCT 27	0.8	1.13
17	OCT 28 - NOV 10	0.9	1.21
18	NOV 11 - NOV 24	0.9	1.21
19	NOV 25 - DEC 8	0.9	1.25
20	DEC 9 - DEC 22	0.8	NOT AVAILABLE
21	DEC 23 - JAN 5	1.0	1.22
22	JAN 6 - JAN 19	1.0	1.25
23	JAN 20 - FEB 2	0.8	1.35
24	FEB 3 - FEB 16	0.8	1.27
25	FEB 17 - MAR 2	0.8	1.28
26	MAR 3 - MAR 16	0.8	0.76

Summary for PORTAGE LA PRAIRIE

Average	0.9	1.14
Minimum	0.8	0.22
Maximum	1.2	1.35
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	RESTON	FLUORIDATOR	W&T A745
OPERATOR	Ken Moore	CHEMICAL	NaF 4 %
PHONE	877-3862	NATURAL FLUORIDE	0.13

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.2	1.10
2 APR 1 - APR 14	1.1	1.10
3 APR 15 - APR 28	0.9	1.00
4 APR 29 - MAY 12	1.2	1.05
5 MAY 13 - MAY 28	1.1	1.00
6 MAY 29 - JUN 9	0.6	1.05
7 JUN 10 - JUN 23	0.4	1.05
8 JUN 24 - JUL 7	0.1	1.00
9 JUL 8 - JUL 21	0.4	1.05
10 JUL 22 - AUG 4	0.4	1.05
11 AUG 5 - AUG 18	0.3	1.10
12 AUG 19 - SEP 1	1.1	1.05
13 SEP 2 - SEP 15	1.0	1.00
14 SEP 16 - SEP 29	1.0	0.95
15 SEP 30 - OCT 13	0.9	1.00
16 OCT 14 - OCT 27	0.9	1.10
17 OCT 28 - NOV 10	0.8	0.95
18 NOV 11 - NOV 24	1.0	1.00
19 NOV 25 - DEC 8	1.0	1.05
20 DEC 9 - DEC 22	2.6	1.05
21 DEC 23 - JAN 5	2.3	1.00
22 JAN 6 - JAN 19	1.0	1.10
23 JAN 20 - FEB 2	0.9	1.00
24 FEB 3 - FEB 16	0.8	1.05
25 FEB 17 - MAR 2	0.8	1.05
26 MAR 3 - MAR 16	1.0	1.05

Summary for RESTON

Average	1.0	1.04
Minimum	0.1	0.95
Maximum	2.6	1.10
Samples Above Limit	2	
Samples Below Limits	6	
% Outside Limits:	31%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION RIVERS	FLUORIDATOR	LMI Saturator
OPERATOR Randy King	CHEMICAL	NaF 4 %
PHONE 328-5250	NATURAL FLUORIDE	0.18

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.1	1.30
2 APR 1 - APR 14	0.9	0.88
3 APR 15 - APR 28	0.5	0.97
4 APR 29 - MAY 12	1.0	1.04
5 MAY 13 - MAY 28	0.9	0.95
6 MAY 29 - JUN 9	1.0	1.00
7 JUN 10 - JUN 23	1.0	0.98
8 JUN 24 - JUL 7	1.0	0.99
9 JUL 8 - JUL 21	0.9	1.17
10 JUL 22 - AUG 4	0.8	1.11
11 AUG 5 - AUG 18	1.0	1.17
12 AUG 19 - SEP 1	0.7	0.90
13 SEP 2 - SEP 15	1.0	1.11
14 SEP 16 - SEP 29	1.0	0.93
15 SEP 30 - OCT 13	0.9	1.05
16 OCT 14 - OCT 27	0.8	0.85
17 OCT 28 - NOV 10	0.8	1.06
18 NOV 11 - NOV 24	0.6	0.82
19 NOV 25 - DEC 8	0.8	1.12
20 DEC 9 - DEC 22	0.8	1.17
21 DEC 23 - JAN 5	0.8	1.14
22 JAN 6 - JAN 19	0.6	1.00
23 JAN 20 - FEB 2	0.8	0.95
24 FEB 3 - FEB 16	0.8	1.21
25 FEB 17 - MAR 2	0.7	0.91
26 MAR 3 - MAR 16	0.9	0.86

Summary for RIVERS

Average	0.9	1.02
Minimum	0.5	0.82
Maximum	1.1	1.30
Samples Above Limit	0	
Samples Below Limits	5	
% Outside Limits:	19%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	ROBLIN	FLUORIDATOR	W&T A745
OPERATOR	Don Todorovich	CHEMICAL	NaF 4 %
PHONE	937-8333	NATURAL FLUORIDE	0.26

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.9	1.05
2 APR 1 - APR 14	1.0	1.05
3 APR 15 - APR 28	0.9	1.00
4 APR 29 - MAY 12	0.9	1.05
5 MAY 13 - MAY 28	1.0	1.00
6 MAY 29 - JUN 9	0.9	1.00
7 JUN 10 - JUN 23	0.9	1.05
8 JUN 24 - JUL 7	0.9	1.15
9 JUL 8 - JUL 21	1.0	1.10
10 JUL 22 - AUG 4	1.0	1.10
11 AUG 5 - AUG 18	0.9	1.05
12 AUG 19 - SEP 1	1.0	1.10
13 SEP 2 - SEP 15	0.9	1.05
14 SEP 16 - SEP 29	1.0	1.10
15 SEP 30 - OCT 13	0.9	1.05
16 OCT 14 - OCT 27	0.9	1.05
17 OCT 28 - NOV 10	0.9	1.10
18 NOV 11 - NOV 24	0.8	1.10
19 NOV 25 - DEC 8	0.8	1.10
20 DEC 9 - DEC 22	0.8	1.00
21 DEC 23 - JAN 5	0.9	1.05
22 JAN 6 - JAN 19	1.0	1.10
23 JAN 20 - FEB 2	0.8	1.10
24 FEB 3 - FEB 16	0.8	1.10
25 FEB 17 - MAR 2	0.7	1.05
26 MAR 3 - MAR 16	0.9	1.00

Summary for ROBLIN

Average	0.9	1.06
Minimum	0.7	1.00
Maximum	1.0	1.15
Samples Above Limit	0	
Samples Below Limits	1	
% Outside Limits:	4%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	ROSSBURN	FLUORIDATOR	W&T A745
OPERATOR	Perry Kretai	CHEMICAL	NaF 4 %
PHONE	859-2762	NATURAL FLUORIDE	0.1

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	1.00
2	APR 1 - APR 14	0.9	1.00
3	APR 15 - APR 28	0.7	0.90
4	APR 29 - MAY 12	0.6	0.90
5	MAY 13 - MAY 28	0.8	0.90
6	MAY 29 - JUN 9	0.8	0.90
7	JUN 10 - JUN 23	1.2	1.00
8	JUN 24 - JUL 7	0.9	1.10
9	JUL 8 - JUL 21	1.0	1.00
10	JUL 22 - AUG 4	0.9	1.10
11	AUG 5 - AUG 18	0.8	1.10
12	AUG 19 - SEP 1	1.1	1.10
13	SEP 2 - SEP 15	0.9	1.10
14	SEP 16 - SEP 29	1.1	1.10
15	SEP 30 - OCT 13	0.8	0.90
16	OCT 14 - OCT 27	0.7	1.00
17	OCT 28 - NOV 10	0.5	0.90
18	NOV 11 - NOV 24	0.5	0.80
19	NOV 25 - DEC 8	0.8	1.10
20	DEC 9 - DEC 22	0.8	1.00
21	DEC 23 - JAN 5	0.8	1.10
22	JAN 6 - JAN 19	1.0	1.00
23	JAN 20 - FEB 2	0.8	0.90
24	FEB 3 - FEB 16	0.8	1.10
25	FEB 17 - MAR 2	0.7	0.90
26	MAR 3 - MAR 16	1.0	1.00

Summary for ROSSBURN

Average	0.8	1.00
Minimum	0.5	0.80
Maximum	1.2	1.10
Samples Above Limit	0	
Samples Below Limits	6	
% Outside Limits:	23%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION RUSSELL	FLUORIDATOR	LMI A151
OPERATOR Mark Moan	CHEMICAL	NaF 4 %
PHONE 773-2253	NATURAL FLUORIDE	0.21

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	1.0	1.03
2	APR 1 - APR 14	1.0	1.08
3	APR 15 - APR 28	0.9	1.03
4	APR 29 - MAY 12	1.0	1.18
5	MAY 13 - MAY 28	1.0	1.13
6	MAY 29 - JUN 9	0.8	1.11
7	JUN 10 - JUN 23	0.8	0.98
8	JUN 24 - JUL 7	0.8	1.01
9	JUL 8 - JUL 21	0.9	1.08
10	JUL 22 - AUG 4	0.9	1.03
11	AUG 5 - AUG 18	0.9	1.13
12	AUG 19 - SEP 1	1.2	1.20
13	SEP 2 - SEP 15	0.8	1.05
14	SEP 16 - SEP 29	1.1	1.08
15	SEP 30 - OCT 13	0.9	1.02
16	OCT 14 - OCT 27	0.8	1.14
17	OCT 28 - NOV 10	1.1	1.19
18	NOV 11 - NOV 24	0.8	1.07
19	NOV 25 - DEC 8	0.8	1.03
20	DEC 9 - DEC 22	0.8	0.99
21	DEC 23 - JAN 5	0.8	0.90
22	JAN 6 - JAN 19	1.0	1.03
23	JAN 20 - FEB 2	0.9	1.09
24	FEB 3 - FEB 16	1.0	1.08
25	FEB 17 - MAR 2	0.8	0.97
26	MAR 3 - MAR 16	1.1	1.04

Summary for RUSSELL

Average	0.9	1.06
Minimum	0.8	0.90
Maximum	1.2	1.20
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	SANFORD (RM MACDONALD)	FLUORIDATOR	W&T
OPERATOR	David Eppler	CHEMICAL	H2SiF6 25 %
PHONE	736-2255	NATURAL FLUORIDE	0.1

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.8	1.00
2 APR 1 - APR 14	0.7	1.00
3 APR 15 - APR 28	0.9	1.00
4 APR 29 - MAY 12	0.9	1.00
5 MAY 13 - MAY 28	0.9	0.90
6 MAY 29 - JUN 9	0.8	0.99
7 JUN 10 - JUN 23	0.9	1.05
8 JUN 24 - JUL 7	0.7	0.93
9 JUL 8 - JUL 21	0.7	0.87
10 JUL 22 - AUG 4	0.9	1.05
11 AUG 5 - AUG 18	0.8	0.96
12 AUG 19 - SEP 1	0.8	0.94
13 SEP 2 - SEP 15	0.9	1.14
14 SEP 16 - SEP 29	1.1	1.04
15 SEP 30 - OCT 13	0.8	1.02
16 OCT 14 - OCT 27	0.8	1.02
17 OCT 28 - NOV 10	1.1	1.02
18 NOV 11 - NOV 24	0.8	1.01
19 NOV 25 - DEC 8	0.8	1.00
20 DEC 9 - DEC 22	0.8	1.02
21 DEC 23 - JAN 5	0.9	1.23
22 JAN 6 - JAN 19	1.0	1.13
23 JAN 20 - FEB 2	0.9	1.06
24 FEB 3 - FEB 16	0.8	1.10
25 FEB 17 - MAR 2	0.8	1.10
26 MAR 3 - MAR 16	1.0	1.03

Summary for SANFORD (RM MACDONALD)

Average	0.9	1.02
Minimum	0.7	0.87
Maximum	1.1	1.23
Samples Above Limit	0	
Samples Below Limits	3	
% Outside Limits:	12%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION SAPOTAWWEYAK

FLUORIDATOR

OPERATOR Horace Cook

CHEMICAL

NaF 4 %

PHONE 587-2125

NATURAL FLUORIDE 0.31

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.6	NOT AVAILABLE
2 APR 1 - APR 14	0.8	NOT AVAILABLE
3 APR 15 - APR 28	1.0	NOT AVAILABLE
4 APR 29 - MAY 12	0.9	NOT AVAILABLE
5 MAY 13 - MAY 28	1.0	NOT AVAILABLE
6 MAY 29 - JUN 9	1.0	NOT AVAILABLE
7 JUN 10 - JUN 23	1.0	NOT AVAILABLE
8 JUN 24 - JUL 7	1.0	NOT AVAILABLE
9 JUL 8 - JUL 21	0.8	NOT AVAILABLE
10 JUL 22 - AUG 4	0.8	NOT AVAILABLE
11 AUG 5 - AUG 18	0.7	NOT AVAILABLE
12 AUG 19 - SEP 1	0.7	NOT AVAILABLE
13 SEP 2 - SEP 15	0.8	NOT AVAILABLE
14 SEP 16 - SEP 29	0.7	NOT AVAILABLE
15 SEP 30 - OCT 13	0.7	NOT AVAILABLE
16 OCT 14 - OCT 27	0.6	NOT AVAILABLE
17 OCT 28 - NOV 10	0.6	NOT AVAILABLE
18 NOV 11 - NOV 24	1.0	NOT AVAILABLE
19 NOV 25 - DEC 8	1.0	NOT AVAILABLE
20 DEC 9 - DEC 22	0.7	NOT AVAILABLE
21 DEC 23 - JAN 5	0.7	NOT AVAILABLE
22 JAN 6 - JAN 19	0.7	NOT AVAILABLE
23 JAN 20 - FEB 2	NOT AVAILABLE	NOT AVAILABLE
24 FEB 3 - FEB 16	NOT AVAILABLE	NOT AVAILABLE
25 FEB 17 - MAR 2	0.6	NOT AVAILABLE
26 MAR 3 - MAR 16	0.8	NOT AVAILABLE

Summary for SAPOTAWWEYAK

Average	0.8
Minimum	0.6
Maximum	1.0
Samples Above Limit	0
Samples Below Limits	11
% Outside Limits:	46%
Number of Samples	24

Fluoride Control Data 2006 / 2007

LOCATION	SHILO	FLUORIDATOR	LMI Saturator
OPERATOR	Bill Burke	CHEMICAL	NaF 4 %
PHONE	765-4723	NATURAL FLUORIDE	0.05

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.1	1.29
2 APR 1 - APR 14	1.0	1.13
3 APR 15 - APR 28	0.9	1.06
4 APR 29 - MAY 12	1.0	1.04
5 MAY 13 - MAY 28	1.0	NOT AVAILABLE
6 MAY 29 - JUN 9	0.9	1.01
7 JUN 10 - JUN 23	1.1	1.07
8 JUN 24 - JUL 7	1.3	1.06
9 JUL 8 - JUL 21	1.0	1.22
10 JUL 22 - AUG 4	0.9	1.11
11 AUG 5 - AUG 18	1.1	1.23
12 AUG 19 - SEP 1	1.1	1.46
13 SEP 2 - SEP 15	1.0	1.20
14 SEP 16 - SEP 29	1.0	1.32
15 SEP 30 - OCT 13	0.6	0.63
16 OCT 14 - OCT 27	NOT AVAILABLE	NOT AVAILABLE
17 OCT 28 - NOV 10	1.0	1.11
18 NOV 11 - NOV 24	0.8	1.01
19 NOV 25 - DEC 8	1.0	1.34
20 DEC 9 - DEC 22	0.9	1.04
21 DEC 23 - JAN 5	0.6	0.62
22 JAN 6 - JAN 19	0.9	0.96
23 JAN 20 - FEB 2	NOT AVAILABLE	NOT AVAILABLE
24 FEB 3 - FEB 16	0.8	1.05
25 FEB 17 - MAR 2	0.6	0.72
26 MAR 3 - MAR 16	NOT AVAILABLE	NOT AVAILABLE

Summary for SHILO

Average	0.9	1.08
Minimum	0.6	0.62
Maximum	1.3	1.46
Samples Above Limit	1	
Samples Below Limits	3	
% Outside Limits:	17%	
Number of Samples	23	

Fluoride Control Data 2006 / 2007

LOCATION SOMERSET
 OPERATOR Remi Messner
 PHONE 744-2179

FLUORIDATOR
 CHEMICAL H₂SiF₆ 25 %
 NATURAL FLUORIDE .02

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.7	0.86
2	APR 1 - APR 14	0.7	1.06
3	APR 15 - APR 28	0.5	1.11
4	APR 29 - MAY 12	0.5	1.07
5	MAY 13 - MAY 28	0.6	1.02
6	MAY 29 - JUN 9	0.6	1.04
7	JUN 10 - JUN 23	0.6	1.02
8	JUN 24 - JUL 7	0.4	1.23
9	JUL 8 - JUL 21	0.6	1.05
10	JUL 22 - AUG 4	0.6	1.00
11	AUG 5 - AUG 18	0.5	1.07
12	AUG 19 - SEP 1	0.7	0.99
13	SEP 2 - SEP 15	0.6	1.20
14	SEP 16 - SEP 29	0.6	1.07
15	SEP 30 - OCT 13	0.6	1.05
16	OCT 14 - OCT 27	0.5	1.17
17	OCT 28 - NOV 10	1.0	1.40
18	NOV 11 - NOV 24	0.8	1.12
19	NOV 25 - DEC 8	0.8	1.12
20	DEC 9 - DEC 22	1.3	1.03
21	DEC 23 - JAN 5	1.7	1.23
22	JAN 6 - JAN 19	1.6	1.28
23	JAN 20 - FEB 2	1.6	1.12
24	FEB 3 - FEB 16	1.2	0.92
25	FEB 17 - MAR 2	1.1	1.03
26	MAR 3 - MAR 16	1.4	0.92

Summary for SOMERSET

Average	0.8	1.08
Minimum	0.4	0.86
Maximum	1.7	1.40
Samples Above Limit	5	
Samples Below Limits	16	
% Outside Limits:	81%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	SOURIS	FLUORIDATOR	LMI Saturator
OPERATOR	Don Bodin and Kelvin Kowalchuk	CHEMICAL	NaF 4 %
PHONE	483-2169	NATURAL FLUORIDE	0.19

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.0	1.26
2 APR 1 - APR 14	0.9	0.99
3 APR 15 - APR 28	0.7	0.89
4 APR 29 - MAY 12	1.0	1.19
5 MAY 13 - MAY 28	1.0	1.10
6 MAY 29 - JUN 9	0.8	NOT AVAILABLE
7 JUN 10 - JUN 23	1.0	1.09
8 JUN 24 - JUL 7	1.2	1.20
9 JUL 8 - JUL 21	0.8	0.86
10 JUL 22 - AUG 4	1.1	0.96
11 AUG 5 - AUG 18	1.1	1.38
12 AUG 19 - SEP 1	1.0	1.01
13 SEP 2 - SEP 15	1.0	1.04
14 SEP 16 - SEP 29	1.0	0.89
15 SEP 30 - OCT 13	1.2	1.22
16 OCT 14 - OCT 27	0.9	0.96
17 OCT 28 - NOV 10	1.0	1.18
18 NOV 11 - NOV 24	1.0	NOT AVAILABLE
19 NOV 25 - DEC 8	0.9	1.14
20 DEC 9 - DEC 22	0.7	1.00
21 DEC 23 - JAN 5	0.8	1.05
22 JAN 6 - JAN 19	0.8	1.20
23 JAN 20 - FEB 2	0.9	1.07
24 FEB 3 - FEB 16	1.0	1.10
25 FEB 17 - MAR 2	1.0	NOT AVAILABLE
26 MAR 3 - MAR 16	0.9	1.00

Summary for SOURIS

Average	1.0	1.08
Minimum	0.7	0.86
Maximum	1.2	1.38
Samples Above Limit	0	
Samples Below Limits	2	
% Outside Limits:	8%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION STEINBACH	FLUORIDATOR	Pulsatron
OPERATOR Jason Hiebert	CHEMICAL	H2SiF6 25 %
PHONE 326-9877	NATURAL FLUORIDE	0.39

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.8	0.92
2	APR 1 - APR 14	0.8	0.90
3	APR 15 - APR 28	0.8	0.97
4	APR 29 - MAY 12	0.7	0.91
5	MAY 13 - MAY 28	0.8	0.91
6	MAY 29 - JUN 9	0.8	0.90
7	JUN 10 - JUN 23	0.8	NOT AVAILABLE
8	JUN 24 - JUL 7	0.8	0.85
9	JUL 8 - JUL 21	0.8	0.96
10	JUL 22 - AUG 4	0.8	1.05
11	AUG 5 - AUG 18	1.0	0.99
12	AUG 19 - SEP 1	0.9	0.98
13	SEP 2 - SEP 15	0.8	NOT AVAILABLE
14	SEP 16 - SEP 29	0.9	0.92
15	SEP 30 - OCT 13	0.8	1.06
16	OCT 14 - OCT 27	0.8	0.93
17	OCT 28 - NOV 10	0.8	0.93
18	NOV 11 - NOV 24	0.8	0.93
19	NOV 25 - DEC 8	0.8	0.93
20	DEC 9 - DEC 22	0.8	0.99
21	DEC 23 - JAN 5	0.8	0.97
22	JAN 6 - JAN 19	0.7	1.19
23	JAN 20 - FEB 2	0.7	0.91
24	FEB 3 - FEB 16	0.8	0.60
25	FEB 17 - MAR 2	0.7	0.82
26	MAR 3 - MAR 16	0.9	0.79

Summary for STEINBACH

Average	0.8	0.93
Minimum	0.7	0.60
Maximum	1.0	1.19
Samples Above Limit	0	
Samples Below Limits	4	
% Outside Limits:	15%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	STEPHENFIELD	FLUORIDATOR	Prominent
OPERATOR	Paul Termeer	CHEMICAL	H2SiF6 25 %
PHONE	828-3434	NATURAL FLUORIDE	0.2

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	1.2	1.45
2 APR 1 - APR 14	1.2	1.29
3 APR 15 - APR 28	1.2	1.09
4 APR 29 - MAY 12	1.1	1.05
5 MAY 13 - MAY 28	1.1	1.09
6 MAY 29 - JUN 9	1.1	1.02
7 JUN 10 - JUN 23	1.3	1.09
8 JUN 24 - JUL 7	1.4	1.30
9 JUL 8 - JUL 21	1.5	1.39
10 JUL 22 - AUG 4	1.2	1.19
11 AUG 5 - AUG 18	1.2	1.14
12 AUG 19 - SEP 1	1.3	NOT AVAILABLE
13 SEP 2 - SEP 15	1.1	1.10
14 SEP 16 - SEP 29	1.0	1.50
15 SEP 30 - OCT 13	0.9	1.14
16 OCT 14 - OCT 27	0.9	1.03
17 OCT 28 - NOV 10	1.0	0.92
18 NOV 11 - NOV 24	0.8	1.00
19 NOV 25 - DEC 8	0.8	0.92
20 DEC 9 - DEC 22	0.8	1.47
21 DEC 23 - JAN 5	0.9	1.10
22 JAN 6 - JAN 19	1.0	1.08
23 JAN 20 - FEB 2	1.0	1.00
24 FEB 3 - FEB 16	1.1	0.84
25 FEB 17 - MAR 2	1.0	0.87
26 MAR 3 - MAR 16	1.2	0.90

Summary for STEPHENFIELD

Average	1.1	1.12
Minimum	0.8	0.84
Maximum	1.5	1.50
Samples Above Limit	4	
Samples Below Limits	0	
% Outside Limits:	15%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION SWAN RIVER	FLUORIDATOR	LMI A741
OPERATOR Eric Arp	CHEMICAL	H2SiF6 25 %
PHONE 734-4586	NATURAL FLUORIDE	0.18

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1 MAR 18 - MAR 31	1.0	1.04
2 APR 1 - APR 14	1.0	0.99
3 APR 15 - APR 28	1.0	1.15
4 APR 29 - MAY 12	1.0	1.02
5 MAY 13 - MAY 28	1.0	1.07
6 MAY 29 - JUN 9	0.9	1.04
7 JUN 10 - JUN 23	1.1	1.09
8 JUN 24 - JUL 7	1.1	1.07
9 JUL 8 - JUL 21	1.1	1.08
10 JUL 22 - AUG 4	1.0	1.09
11 AUG 5 - AUG 18	0.9	1.21
12 AUG 19 - SEP 1	1.1	1.18
13 SEP 2 - SEP 15	0.9	1.08
14 SEP 16 - SEP 29	1.1	1.06
15 SEP 30 - OCT 13	0.9	1.07
16 OCT 14 - OCT 27	0.9	1.09
17 OCT 28 - NOV 10	0.7	1.09
18 NOV 11 - NOV 24	0.9	1.13
19 NOV 25 - DEC 8	0.9	1.10
20 DEC 9 - DEC 22	0.9	1.09
21 DEC 23 - JAN 5	1.0	0.99
22 JAN 6 - JAN 19	1.0	1.09
23 JAN 20 - FEB 2	1.0	1.03
24 FEB 3 - FEB 16	1.0	1.12
25 FEB 17 - MAR 2	1.0	0.98
26 MAR 3 - MAR 16	1.2	1.07

Summary for SWAN RIVER

Average	1.0	1.08
Minimum	0.7	0.98
Maximum	1.2	1.21
Samples Above Limit	0	
Samples Below Limits	1	
% Outside Limits:	4%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	THE PAS	FLUORIDATOR	W&T 32-050
OPERATOR	Ronald Stewart	CHEMICAL	H2SiF6 25 %
PHONE	627-1142	NATURAL FLUORIDE	0.15

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	1.00
2	APR 1 - APR 14	0.9	1.00
3	APR 15 - APR 28	0.8	0.90
4	APR 29 - MAY 12	0.9	1.10
5	MAY 13 - MAY 28	0.9	1.00
6	MAY 29 - JUN 9	0.8	1.10
7	JUN 10 - JUN 23	0.9	1.10
8	JUN 24 - JUL 7	0.7	0.80
9	JUL 8 - JUL 21	0.8	1.00
10	JUL 22 - AUG 4	0.9	1.00
11	AUG 5 - AUG 18	0.8	1.10
12	AUG 19 - SEP 1	1.0	1.05
13	SEP 2 - SEP 15	0.9	1.00
14	SEP 16 - SEP 29	1.0	1.00
15	SEP 30 - OCT 13	0.9	1.00
16	OCT 14 - OCT 27	0.9	0.90
17	OCT 28 - NOV 10	1.0	0.90
18	NOV 11 - NOV 24	1.0	1.00
19	NOV 25 - DEC 8	0.9	1.00
20	DEC 9 - DEC 22	1.0	1.20
21	DEC 23 - JAN 5	1.0	1.00
22	JAN 6 - JAN 19	1.0	1.00
23	JAN 20 - FEB 2	1.0	1.00
24	FEB 3 - FEB 16	1.0	1.00
25	FEB 17 - MAR 2	1.0	1.00
26	MAR 3 - MAR 16	1.1	1.10

Summary for THE PAS

Average	0.9	1.01
Minimum	0.7	0.80
Maximum	1.1	1.20
Samples Above Limit	0	
Samples Below Limits	1	
% Outside Limits:	4%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION TREHERNE	FLUORIDATOR	LMI A741
OPERATOR Ken Lawrence	CHEMICAL	Na2SiF6 (Dry)
PHONE 723-2044	NATURAL FLUORIDE	0.32

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.9	1.00
2 APR 1 - APR 14	1.0	1.00
3 APR 15 - APR 28	0.9	1.00
4 APR 29 - MAY 12	0.9	1.00
5 MAY 13 - MAY 28	1.0	1.00
6 MAY 29 - JUN 9	0.9	1.00
7 JUN 10 - JUN 23	0.9	1.00
8 JUN 24 - JUL 7	0.9	1.00
9 JUL 8 - JUL 21	0.9	0.90
10 JUL 22 - AUG 4	0.9	1.00
11 AUG 5 - AUG 18	0.9	1.00
12 AUG 19 - SEP 1	0.9	1.00
13 SEP 2 - SEP 15	0.9	1.00
14 SEP 16 - SEP 29	1.0	1.00
15 SEP 30 - OCT 13	0.9	1.00
16 OCT 14 - OCT 27	0.8	1.00
17 OCT 28 - NOV 10	1.0	0.90
18 NOV 11 - NOV 24	0.9	1.00
19 NOV 25 - DEC 8	0.9	0.90
20 DEC 9 - DEC 22	1.0	1.00
21 DEC 23 - JAN 5	0.9	1.00
22 JAN 6 - JAN 19	1.0	1.00
23 JAN 20 - FEB 2	0.9	1.00
24 FEB 3 - FEB 16	0.8	1.00
25 FEB 17 - MAR 2	0.8	1.00
26 MAR 3 - MAR 16	1.0	1.00

Summary for TREHERNE

Average	0.9	0.99
Minimum	0.8	0.90
Maximum	1.0	1.00
Samples Above Limit	0	
Samples Below Limits	0	
% Outside Limits:	0%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	VIRDEN	FLUORIDATOR	LMI A751
OPERATOR	Norm Baxter	CHEMICAL	NaF 4 %
PHONE	748-2440	NATURAL FLUORIDE	0.44

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.8	0.87
2	APR 1 - APR 14	0.9	0.97
3	APR 15 - APR 28	0.8	0.91
4	APR 29 - MAY 12	0.8	0.70
5	MAY 13 - MAY 28	0.7	0.81
6	MAY 29 - JUN 9	0.9	1.11
7	JUN 10 - JUN 23	0.9	0.75
8	JUN 24 - JUL 7	1.0	0.84
9	JUL 8 - JUL 21	0.9	1.14
10	JUL 22 - AUG 4	0.9	1.13
11	AUG 5 - AUG 18	0.7	0.69
12	AUG 19 - SEP 1	0.9	1.00
13	SEP 2 - SEP 15	0.8	0.99
14	SEP 16 - SEP 29	0.8	0.54
15	SEP 30 - OCT 13	0.8	0.35
16	OCT 14 - OCT 27	0.8	0.68
17	OCT 28 - NOV 10	0.8	0.74
18	NOV 11 - NOV 24	0.8	0.53
19	NOV 25 - DEC 8	0.7	0.38
20	DEC 9 - DEC 22	0.9	0.93
21	DEC 23 - JAN 5	0.8	0.74
22	JAN 6 - JAN 19	1.0	0.54
23	JAN 20 - FEB 2	1.0	0.71
24	FEB 3 - FEB 16	0.8	0.88
25	FEB 17 - MAR 2	0.8	1.15
26	MAR 3 - MAR 16	0.9	0.90

Summary for VIRDEN

Average	0.8	0.81
Minimum	0.7	0.35
Maximum	1.0	1.15
Samples Above Limit	0	
Samples Below Limits	3	
% Outside Limits:	12%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	WABOWDEN	FLUORIDATOR	Prominent
OPERATOR	Clarence Bayer	CHEMICAL	H ₂ SiF ₆ 25 %
PHONE	689-2165	NATURAL FLUORIDE	< 0.10

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.7	0.80
2 APR 1 - APR 14	1.0	NOT AVAILABLE
3 APR 15 - APR 28	1.2	1.20
4 APR 29 - MAY 12	0.8	0.80
5 MAY 13 - MAY 28	0.9	0.90
6 MAY 29 - JUN 9	1.1	NOT AVAILABLE
7 JUN 10 - JUN 23	1.3	1.20
8 JUN 24 - JUL 7	1.2	1.20
9 JUL 8 - JUL 21	1.3	NOT AVAILABLE
10 JUL 22 - AUG 4	1.1	NOT AVAILABLE
11 AUG 5 - AUG 18	0.8	1.10
12 AUG 19 - SEP 1	1.0	0.88
13 SEP 2 - SEP 15	1.3	1.30
14 SEP 16 - SEP 29	0.9	1.00
15 SEP 30 - OCT 13	0.8	0.90
16 OCT 14 - OCT 27	0.7	0.90
17 OCT 28 - NOV 10	1.0	0.80
18 NOV 11 - NOV 24	1.0	1.00
19 NOV 25 - DEC 8	1.0	1.20
20 DEC 9 - DEC 22	1.0	0.90
21 DEC 23 - JAN 5	1.1	1.26
22 JAN 6 - JAN 19	1.0	1.20
23 JAN 20 - FEB 2	1.1	1.20
24 FEB 3 - FEB 16	1.0	1.10
25 FEB 17 - MAR 2	1.0	1.10
26 MAR 3 - MAR 16	0.9	0.90

Summary for WABOWDEN

Average	1.0	1.04
Minimum	0.7	0.80
Maximum	1.3	1.30
Samples Above Limit	3	
Samples Below Limits	2	
% Outside Limits:	19%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION	WINKLER	FLUORIDATOR	Prominent
OPERATOR	Travis Duff	CHEMICAL	H2SiF6 25 %
PHONE	325-8711	NATURAL FLUORIDE	0.26

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	0.98
2	APR 1 - APR 14	0.7	0.90
3	APR 15 - APR 28	0.8	1.02
4	APR 29 - MAY 12	0.8	0.99
5	MAY 13 - MAY 28	0.8	NOT AVAILABLE
6	MAY 29 - JUN 9	0.7	1.01
7	JUN 10 - JUN 23	0.8	0.92
8	JUN 24 - JUL 7	0.8	0.92
9	JUL 8 - JUL 21	0.7	0.81
10	JUL 22 - AUG 4	0.8	0.82
11	AUG 5 - AUG 18	0.8	1.10
12	AUG 19 - SEP 1	0.9	NOT AVAILABLE
13	SEP 2 - SEP 15	0.8	1.11
14	SEP 16 - SEP 29	0.8	1.00
15	SEP 30 - OCT 13	0.8	1.14
16	OCT 14 - OCT 27	0.8	0.97
17	OCT 28 - NOV 10	0.8	1.22
18	NOV 11 - NOV 24	0.8	1.27
19	NOV 25 - DEC 8	0.8	0.97
20	DEC 9 - DEC 22	0.9	1.12
21	DEC 23 - JAN 5	1.0	0.83
22	JAN 6 - JAN 19	1.0	1.20
23	JAN 20 - FEB 2	0.9	1.20
24	FEB 3 - FEB 16	0.7	0.96
25	FEB 17 - MAR 2	0.8	0.93
26	MAR 3 - MAR 16	0.9	0.78

Summary for WINKLER

Average	0.8	1.01
Minimum	0.7	0.78
Maximum	1.0	1.27
Samples Above Limit	0	
Samples Below Limits	4	
% Outside Limits:	15%	
Number of Samples	26	

Fluoride Control Data 2006 / 2007

LOCATION WINNIPEG	FLUORIDATOR	W&T
OPERATOR Frank DeVries	CHEMICAL	H2SiF6 25 %
PHONE 986-4752	NATURAL FLUORIDE	0.1

Sampling Period	Lab Fluoride	Operator Fluoride
-----------------	--------------	-------------------

1	MAR 18 - MAR 31	0.9	NOT AVAILABLE
2	APR 1 - APR 14	0.9	NOT AVAILABLE
3	APR 15 - APR 28	1.0	NOT AVAILABLE
4	APR 29 - MAY 12	NOT AVAILABLE	NOT AVAILABLE
5	MAY 13 - MAY 28	NOT AVAILABLE	NOT AVAILABLE
6	MAY 29 - JUN 9	0.9	NOT AVAILABLE
7	JUN 10 - JUN 23	1.0	NOT AVAILABLE
8	JUN 24 - JUL 7	0.9	NOT AVAILABLE
9	JUL 8 - JUL 21	0.9	NOT AVAILABLE
10	JUL 22 - AUG 4	0.9	NOT AVAILABLE
11	AUG 5 - AUG 18	0.8	NOT AVAILABLE
12	AUG 19 - SEP 1	0.9	NOT AVAILABLE
13	SEP 2 - SEP 15	1.0	NOT AVAILABLE
14	SEP 16 - SEP 29	0.9	NOT AVAILABLE
15	SEP 30 - OCT 13	0.8	NOT AVAILABLE
16	OCT 14 - OCT 27	0.8	NOT AVAILABLE
17	OCT 28 - NOV 10	1.0	NOT AVAILABLE
18	NOV 11 - NOV 24	0.8	NOT AVAILABLE
19	NOV 25 - DEC 8	0.8	NOT AVAILABLE
20	DEC 9 - DEC 22	0.9	NOT AVAILABLE
21	DEC 23 - JAN 5	0.8	NOT AVAILABLE
22	JAN 6 - JAN 19	1.0	NOT AVAILABLE
23	JAN 20 - FEB 2	0.8	NOT AVAILABLE
24	FEB 3 - FEB 16	0.8	NOT AVAILABLE
25	FEB 17 - MAR 2	0.7	NOT AVAILABLE
26	MAR 3 - MAR 16	0.8	NOT AVAILABLE

Summary for WINNIPEG

Average	0.9
Minimum	0.7
Maximum	1.0
Samples Above Limit	0
Samples Below Limits	1
% Outside Limits:	4%
Number of Samples	24

Fluoride Control Data 2006 / 2007

LOCATION WINNIPEGOSIS

FLUORIDATOR

LMI Saturator

OPERATOR Dan Rempel

CHEMICAL

NaF 4 %

PHONE 656-4791

NATURAL FLUORIDE 0.15

Sampling Period	Lab Fluoride	Operator Fluoride
1 MAR 18 - MAR 31	0.8	0.64
2 APR 1 - APR 14	0.9	0.65
3 APR 15 - APR 28	0.9	0.54
4 APR 29 - MAY 12	0.9	0.53
5 MAY 13 - MAY 28	0.9	0.54
6 MAY 29 - JUN 9	0.9	0.59
7 JUN 10 - JUN 23	1.0	0.61
8 JUN 24 - JUL 7	0.9	0.78
9 JUL 8 - JUL 21	0.9	0.58
10 JUL 22 - AUG 4	0.9	0.56
11 AUG 5 - AUG 18	0.9	0.56
12 AUG 19 - SEP 1	1.0	0.53
13 SEP 2 - SEP 15	0.9	0.54
14 SEP 16 - SEP 29	1.0	0.50
15 SEP 30 - OCT 13	0.8	0.51
16 OCT 14 - OCT 27	0.8	0.47
17 OCT 28 - NOV 10	0.8	0.41
18 NOV 11 - NOV 24	0.8	0.44
19 NOV 25 - DEC 8	0.8	0.41
20 DEC 9 - DEC 22	0.9	0.66
21 DEC 23 - JAN 5	1.0	1.05
22 JAN 6 - JAN 19	1.0	1.00
23 JAN 20 - FEB 2	1.0	1.05
24 FEB 3 - FEB 16	1.0	1.00
25 FEB 17 - MAR 2	0.9	0.83
26 MAR 3 - MAR 16	1.1	0.89

Summary for WINNIPEGOSIS

Average

0.9

0.65

Minimum

0.8

0.41

Maximum

1.1

1.05

Samples Above Limit

0

Samples Below Limits

0

% Outside Limits:

0%

Number of Samples

26

